



PROJECT DATATABLE - SINGLE FAMILY DWELLING SUBDIVISION				
Address	1905 Lee Avenue LOT 4 PLAN 5969 SECTION 76 VICTORIA			
Lot Size	234.75m ² (2526.83 ft ²)			
Zoning	SITE SPECIFIC			
	Existing Lot 4A (To Remain)	Proposed Lot 4B	R1-S2	Specialized
Floor Area of the Principal Building				
Upper Floor Area	N/A	65.01m ² (699.75 ft ²)	-	-
Main Floor Area	75.07m ² (808.06 ft ²)	64.84m ² (697.93 ft ²)	-	-
Basement Floor Area	74.10m ² (797.61 ft ²)	56.53m ² (608.48 ft ²)	-	-
Floor area, for the first and second storeys combined (maximum)	75.07m ² (808.06 ft ²)	129.85m ² (1,397.68 ft ²)	190 m ² (2,054.14 ft ²)	-
Floor area, of all floor levels combined (maximum) (lot area < 669m ²)	149.17m ² (1605.67 ft ²)	186.38m ² (2006.16 ft ²)	-	-
Height, Storeys				
Average grade	17.23m Existing to Remain	16.72m Geo.	-	-
Residential building* (maximum)	4.87m Existing to Remain	7.46m (24.48 ft)	7.60m (24.93 ft)	-
Storeys	1 Existing to Remain	2 Storeys*	2 Storeys	-
Setbacks, Projections				
Front yard setback (minimum)	9.03m (29.63 ft)	2.49m (8.17 ft)	6.00m (19.69 ft)	2.4m (7.87 ft)
Maximum projections into front setback: - slope less than 1.7m in height	N/A	N/A	2.50m (8.20 ft)	-
Maximum projections into front setback: - roof	N/A	N/A	1.60m (5.25 ft)	-
Rear yard setback* (minimum)	1.99m (6.53 ft)	2.41m (7.91 ft)	6.00m (19.69 ft)	2.4m (7.87 ft)
Interior side yard setback (minimum) (East / North)	1.65m (5.41 ft)	6.09m (19.98 ft)	2.4m (7.87 ft)	-
Interior side yard setback (minimum) (West / South)	2.16m (7.09 ft) existing non- conforming	2.43m (7.97 ft)	2.4m (7.87 ft)	-
Lot area				
Site area (minimum)	262.13m ² (2821.54 ft ²)	234.75m ² (2526.83 ft ²)	260m ² (2796.62 ft ²)	234.75m ² (2526.83 ft ²)
Floor space ratio				
Floor space ratio (minimum)	0.29 75.07m ² (808.06 ft ²)	0.55 129.85m ² (1,397.68 ft ²)	0.6 (140.85m ²) (1516.10 ft ²)	-
Site Coverage, Parking				
Site coverage (maximum)	30.78% 80.68m ² (868.43 ft ²)	36.90% 86.62m ² (932.37 ft ²)	40.0% 93.9m ² (1010.73 ft ²)	-
Bicycle Storage - Long Term Storage Spaces - Short Term Storage Spaces	N/A	N/A	N/A	N/A
Parking	1	1	1	-

SITE PLAN
SCALE: 1 : 100

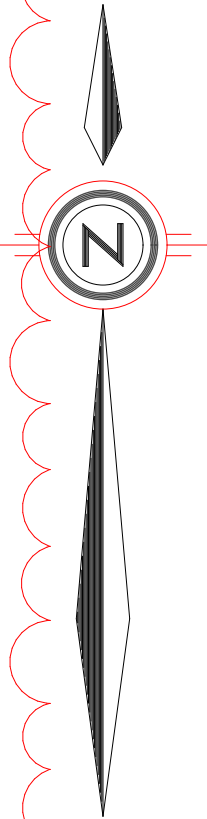

FMON 15-90

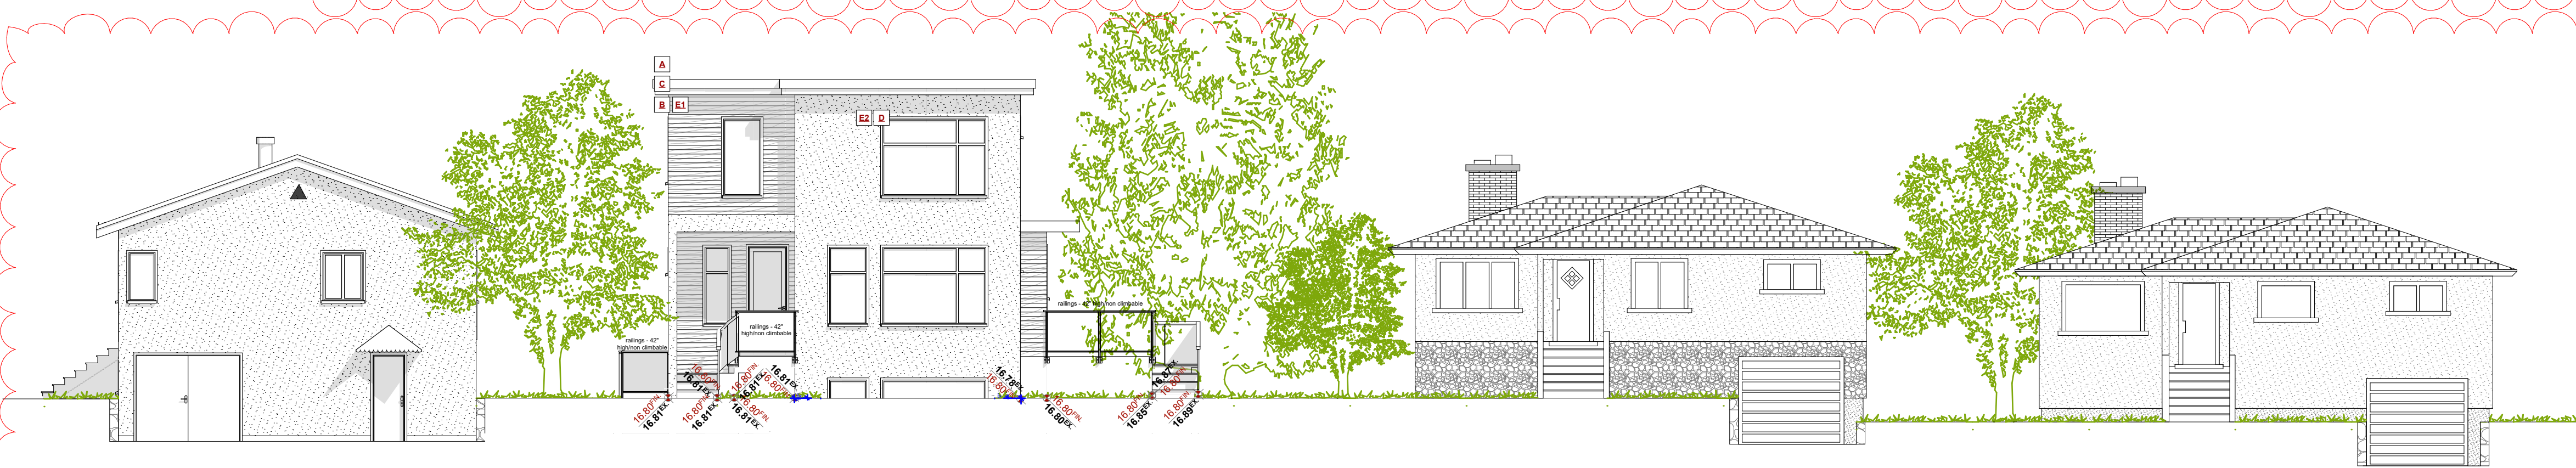

STREETSCAPE - BOURCHIER ST
SCALE: 1/8" = 1' - 0"

NAFS REQUIREMENTS:
Performance Grade of 30
Water Test Pressure of 260 Pa

GENERAL NOTES

ALL MATERIALS AND CONSTRUCTION METHODS TO CONFORM TO THE CURRENT EDITION OF THE BRITISH COLUMBIA BUILDING CODE AS WELL AS ANY LOCAL BUILDING CODES OR BYLAWS WHICH MAY TAKE PRECEDENCE.

ALL MEASUREMENTS MUST BE VERIFIED ON SITE BY BUILDER PRIOR TO CONSTRUCTION, AND ANY DISCREPANCIES REPORTED TO THE DESIGNER.

DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE

-SMOKE DETECTORS SHALL BE PROVIDED ON EVERY FLOOR

SITE PLAN

ALL LAYOUTS SHOULD BE CONFIRMED BY A REGISTERED B.C. LAND SURVEYOR. ALL SETBACKS SHALL BE CONFIRMED BY THE OWNER/BUILDER. ALL GRADE ELEVATIONS ARE THE RESPONSIBILITY OF THE OWNER/BUILDER AND ANY MODIFICATIONS ARE TO BE MADE ON SITE.

CONFORMITY OF THESE PLANS TO THE ACTUAL SITE IS THE RESPONSIBILITY OF THE OWNER/BUILDER.

CONCRETE AND FOUNDATIONS

ALL CONCRETE FOOTINGS TO HAVE SOLID BEARING ON COMPACTED, UNDISTURBED INORGANIC SOIL TO A SUITABLE DEPTH BELOW FROST PENETRATION.

IF SOFTER CONDITIONS APPLY, THE SOLID BEARING CAPACITY

AND SIZE OF FOOTINGS ARE TO BE DESIGNED BY A QUALIFIED ENGINEER. GARAGE & CARPORT FLOORS AND EXTERIOR STEPS SHALL NOT BE LESS THAN 32 MPa

FOUNDATION CONCRETE SHALL HAVE MIN. COMPRESSIVE STRENGTH OF 2900 psi (20MPa) AT 28 DAYS, MIXED, PLACED AND TESTED IN ACCORDANCE WITH CAN3-A438.

ALL WALLS ARE 8" CONCRETE UNLESS OTHERWISE NOTED. ALL GRADES ARE ESTIMATED ONLY AND SHALL BE ADJUSTED ON SITE. ALL WOOD IN CONTACT WITH CONCRETE SHALL BE TREATED OR SEPARATED BY A MOISTURE RESISTANT GASKET MATERIAL.

LUMBER, FRAMING AND BEAMS

BUILDING FRAMES TO BE ANCHORED TO FOUNDATION BY FASTENING SILL PLATE TO FOUNDATION WITH NOT LESS THAN 12.7mm DIAM ANCHOR BOLTS AT NOT MORE THAN 2.4M O.C.

ALL ENGINEERED BEAMS TO BE SIZED BY SUPPLIER.

ALL SPANS SHALL CONFORM TO THE TABLES SET OUT IN "THE SPAN BOOK" AND THE NATIONAL BUILDING CODE OF CANADA AND VERIFICATIONS OF ALL SPANS IS THE RESPONSIBILITY OF THE OWNER/BUILDER.

TRUSSES

TRUSSES AND LAYOUT ARE TO BE ENGINEERED AND INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS, INCLUDING ALL BRACING.

ROOFING ALL ROOFING SHALL BE APPLIED TO MANUFACTURER'S SPECIFICATION AND SHALL INCLUDE EAVE PROTECTION FROM ICE DAMS AND SNOW BUILD UP.

PLUMBING & ELECTRICAL ANY ELECTRICAL SHOWN ON PLANS IS TO SERVE AS A GUIDE ONLY AND MUST BE INSTALLED BY A QUALIFIED PERSONNEL.

FLASHING

ALL EXPOSED OPENINGS SHALL BE PROVIDED WITH ADEQUATE FLASHING. ALL ROOFING SHALL INCORPORATE STEP FLASHING. ALL PENETRATIONS THROUGH ROOF SHALL INCLUDE APPROPRIATE FLASHING. DOORS - ROUGH OPENING SIZES FRAME HEIGHT 83" FOR EXTERIOR DOORS AND 82.5" FOR INTERIOR DOORS. FRAME OPENING 1 1/4" WIDER THAN BIFOLD DOORS AND FRAME HEIGHT 81.5".

MISC. CARBON MONOXIDE ALARMS TO BE HARDWIRED AND WITHIN 5M OF EACH BEDROOM IN EVERY SUITE AND INTERCONNECTED TO ALL FLOORS. CARBON MONOXIDE ALARMS TO CONFORM TO CSA 6.19

NEITHER JAVADESIGNS INC.

NOR THE DESIGNER ACCEPT RESPONSIBILITY FOR THE FOLLOWING:

-INFORMATION PROVIDED ON EXISTING BUILDINGS OR SITE. -CONFORMITY OF PLANS TO SITE. -ERRORS AND OMISSIONS -ANY HOUSE BUILT FROM THESE PLANS

DRAWING NAME:
SITE PLAN, DATA BOX &
STREETSCAPE

ISSUE DATE:
FEB 16, 2020

CUSTOMER:
MARIA WEEKS

DRAWN BY:
KYLE LEGGETT


ADDRESS:
1905 LEE AVE.
LOT 4 PLAN 5969 SECTION 76 VICTORIA

DRAWING SCALE:
SEE DRAWINGS



JAVA DESIGNS
WHERE LINES ON PAPER BECOME WALLS ON SITE
PH 250.590.2468 FX 250.590.4577 www.javadesigns.ca

SHEET
NUMBER


A1




Revisions
Bubbled areas indicate revisions compared to the previously submitted plans
Received Date:
February 25, 2021

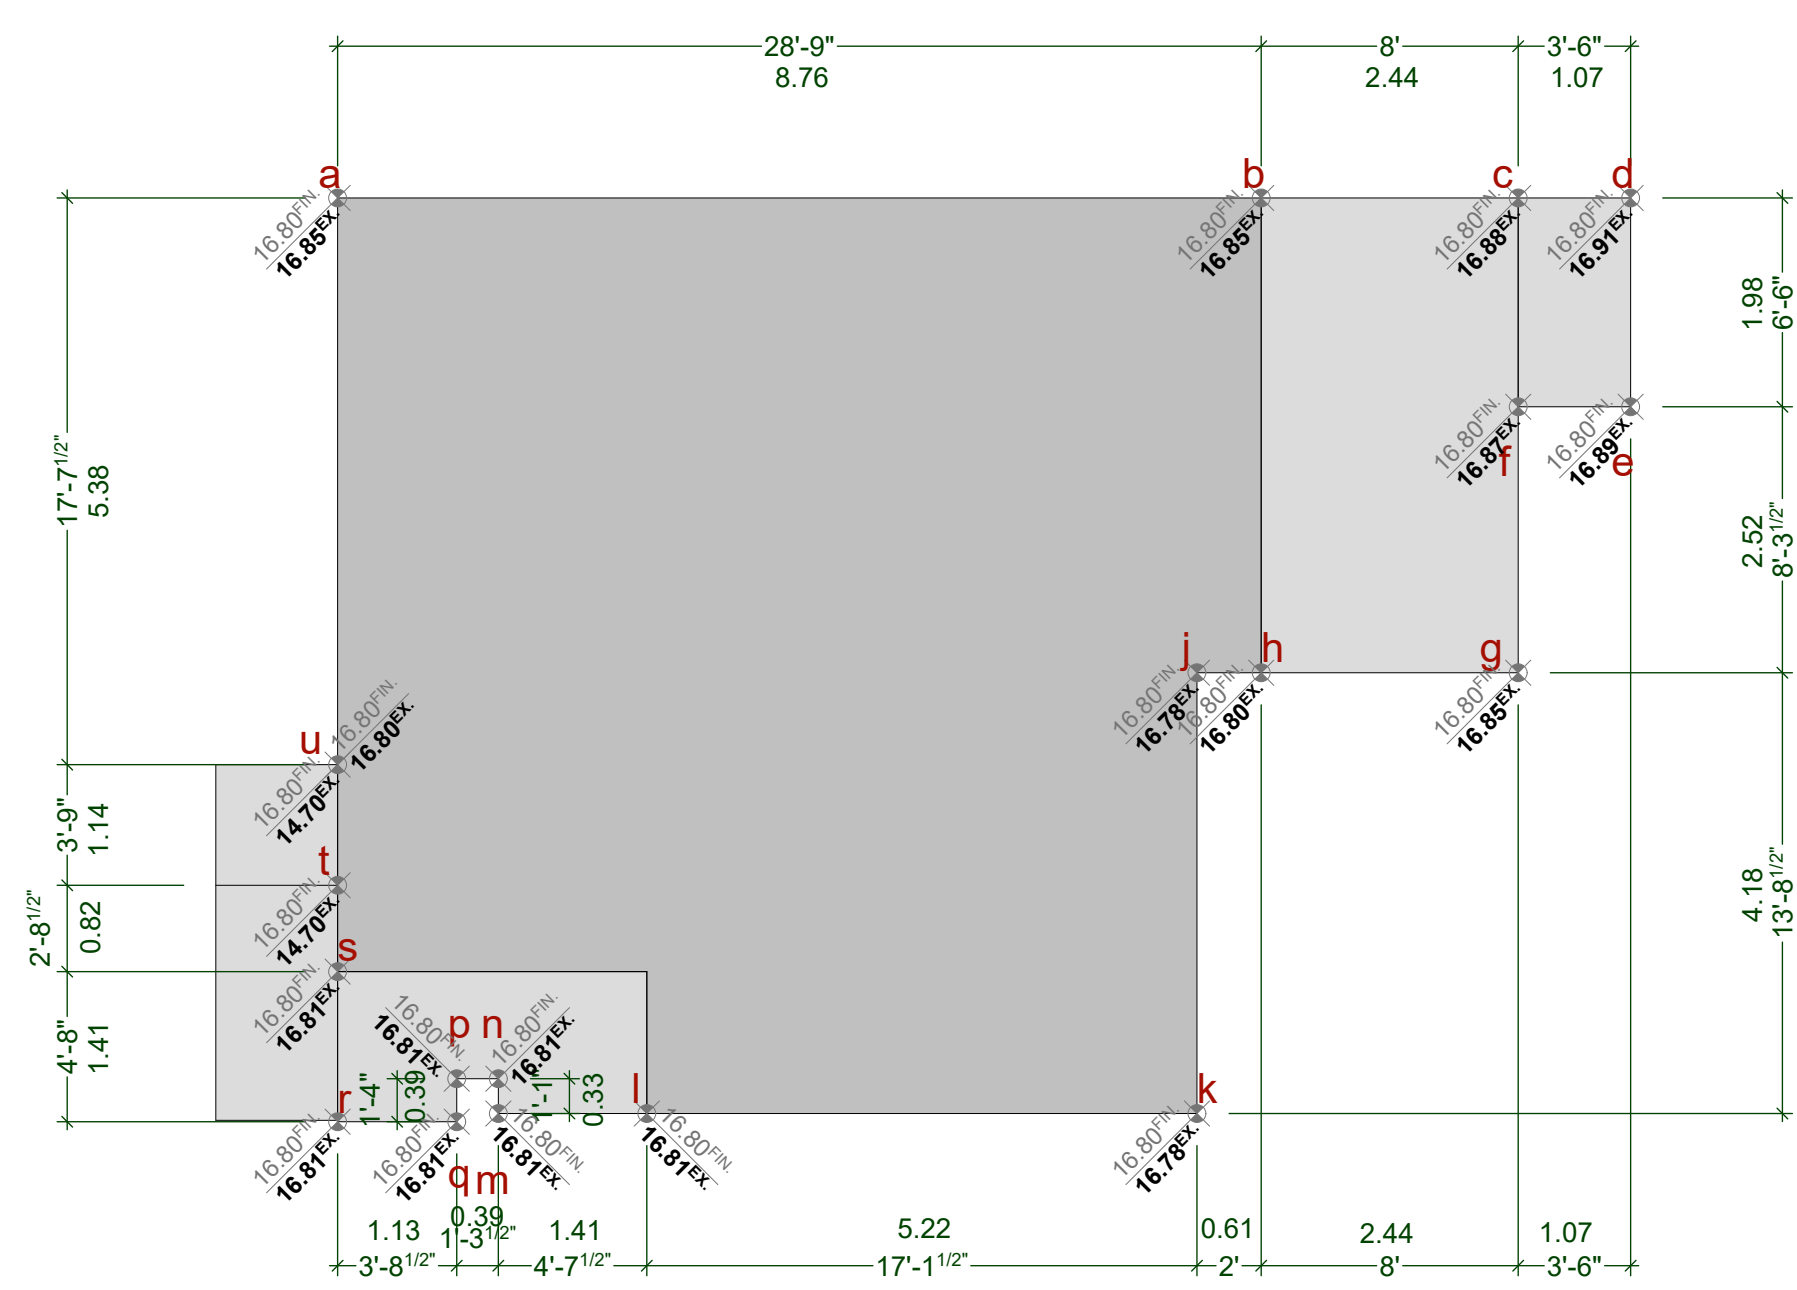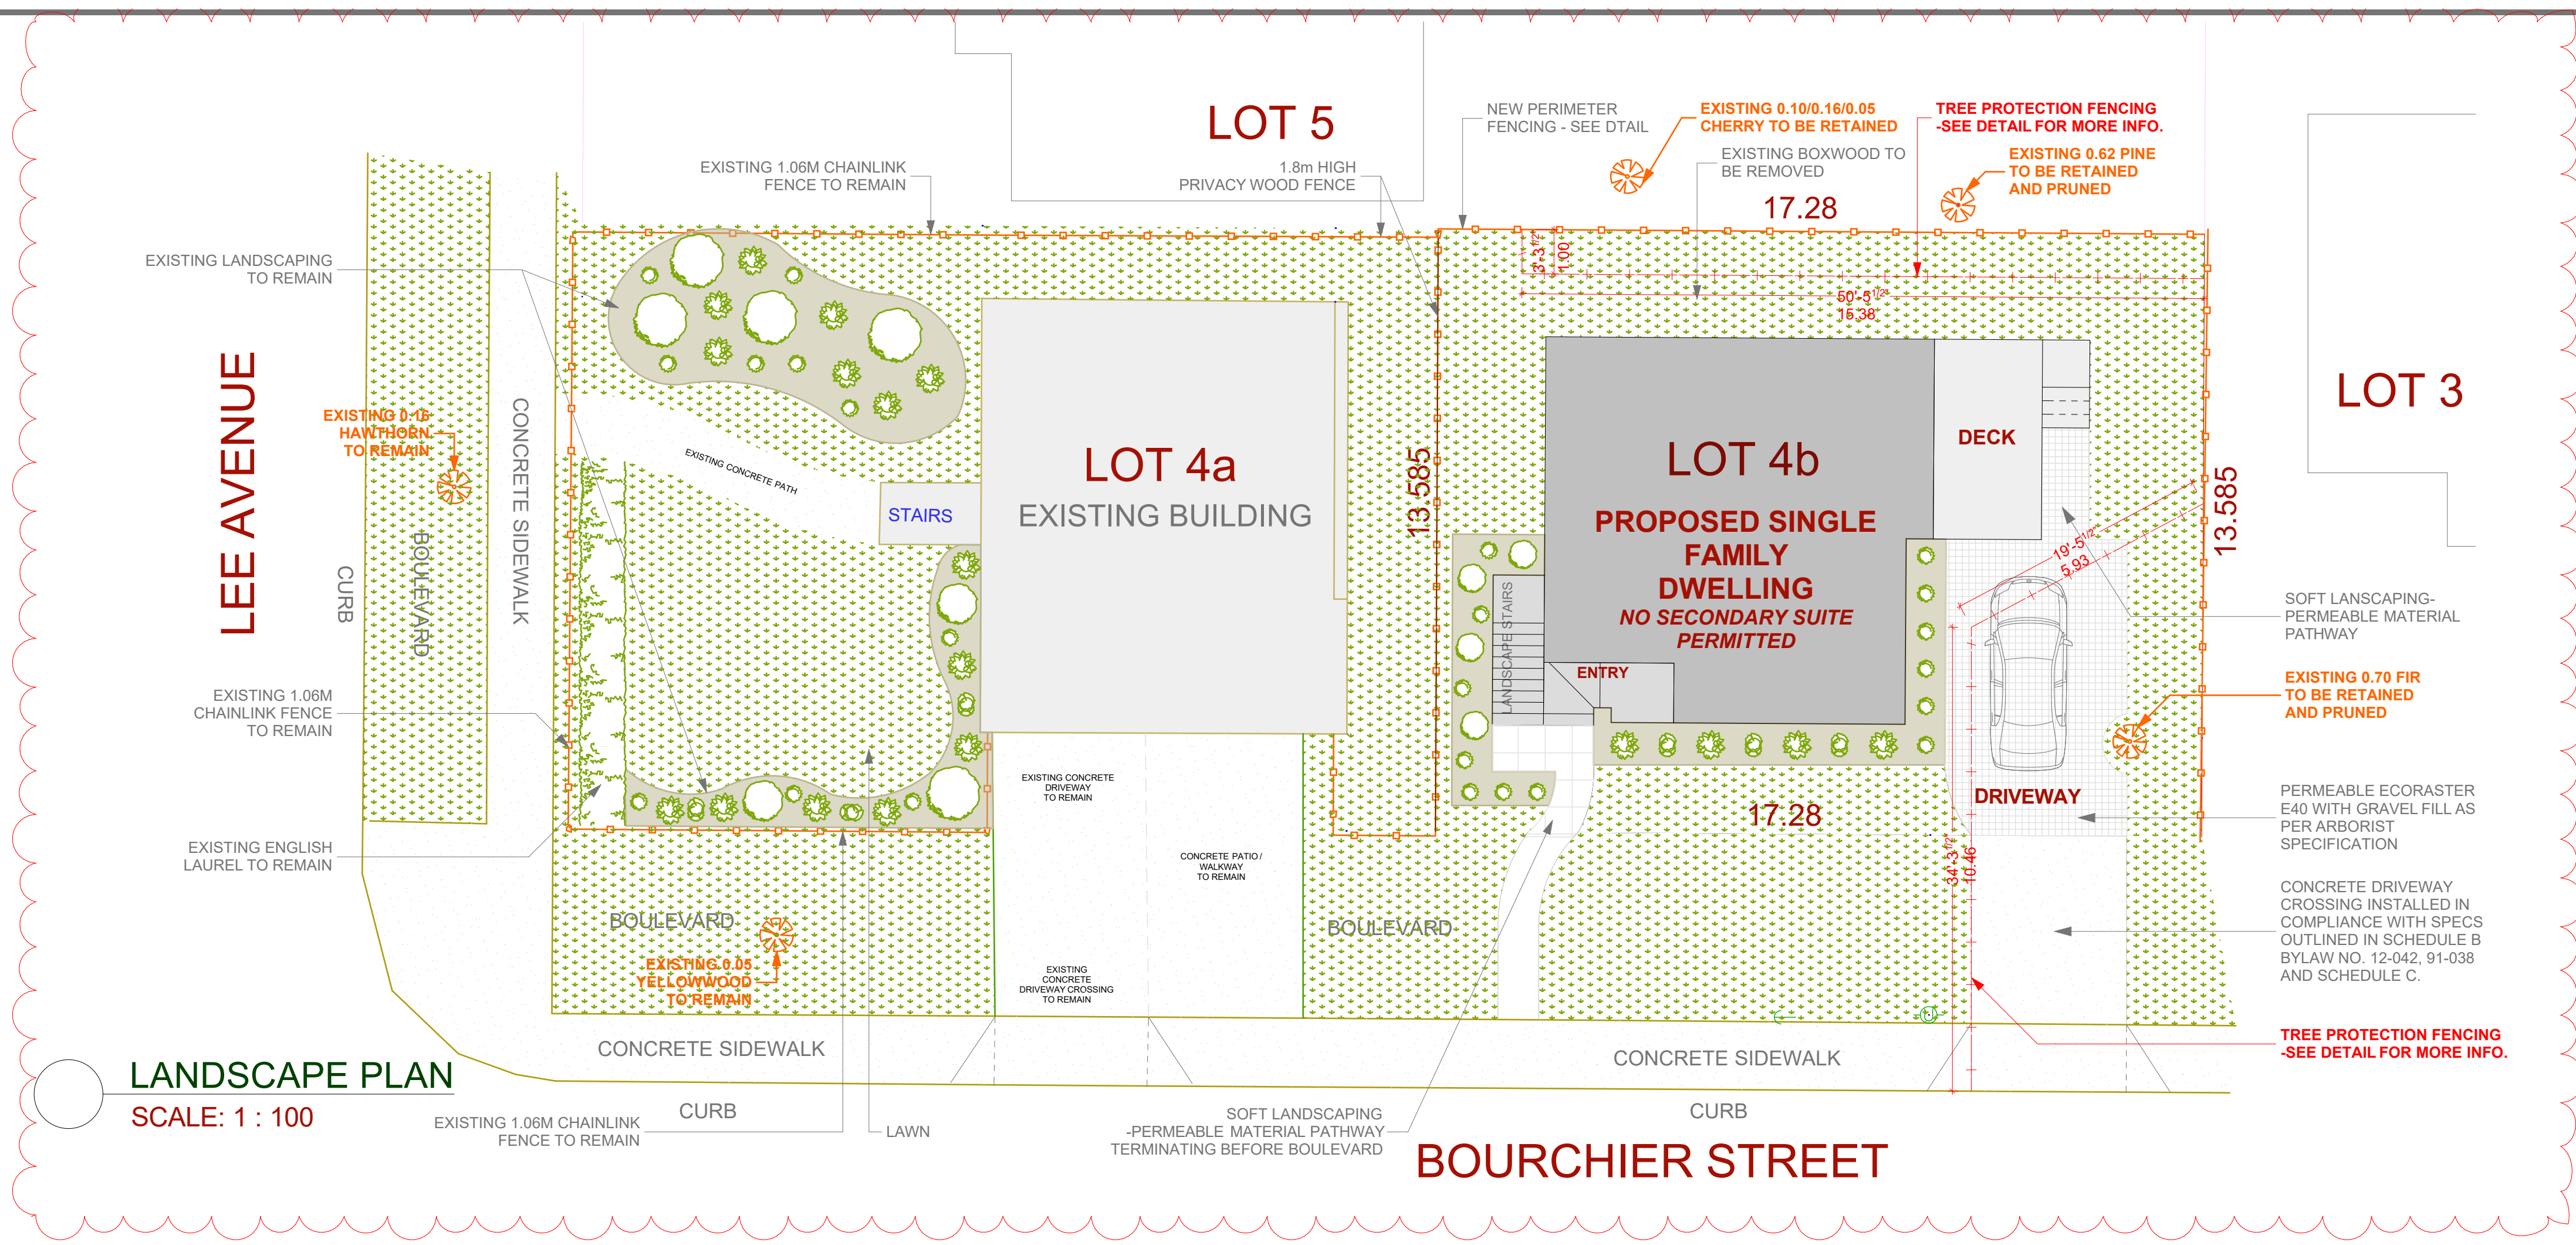


GRADE PLAN				
NOT TO SCALE				
Grade Points	Avg. Of Points	Distance Between	Totals	
a/b	16.80 + 16.80 /2 = 16.80	8.76	147.17	
b/c	16.80 + 16.80 /2 = 16.80	2.44	40.99	
c/d	16.80 + 16.80 /2 = 16.80	1.07	17.98	
d/e	16.80 + 16.80 /2 = 16.80	1.98	33.26	
e/f	16.80 + 16.80 /2 = 16.80	1.07	17.98	
f/g	16.80 + 16.80 /2 = 16.80	2.52	42.34	
g/h	16.80 + 16.80 /2 = 16.80	2.44	40.99	
h/j	16.80 + 16.78 /2 = 16.79	.61	10.24	
j/k	16.78 + 16.80 /2 = 16.79	4.18	70.18	
k/l	16.80 + 16.80 /2 = 16.80	5.22	87.70	
l/m	16.80 + 16.80 /2 = 16.80	1.41	23.69	
m/n	16.80 + 16.80 /2 = 16.80	.33	5.54	
n/p	16.80 + 16.80 /2 = 16.80	.39	6.55	
p/q	16.80 + 16.80 /2 = 16.80	.39	6.55	
q/r	16.80 + 16.80 /2 = 16.80	1.13	18.98	
r/s	16.80 + 16.80 /2 = 16.80	1.41	23.69	
s/t	16.80 + 14.70 /2 = 15.75	0.82	12.92	
t/u	14.70 + 14.70 /2 = 14.70	1.14	16.76	
u/a	16.80 + 16.80 /2 = 16.80	5.38	90.38	
Total:			713.89	
Permitter:			42.69	
AVG. GRADE =			16.72m	
ALLOWED HEIGHT (7.60m)			24.32m	
(16.72 + 7.60m)				

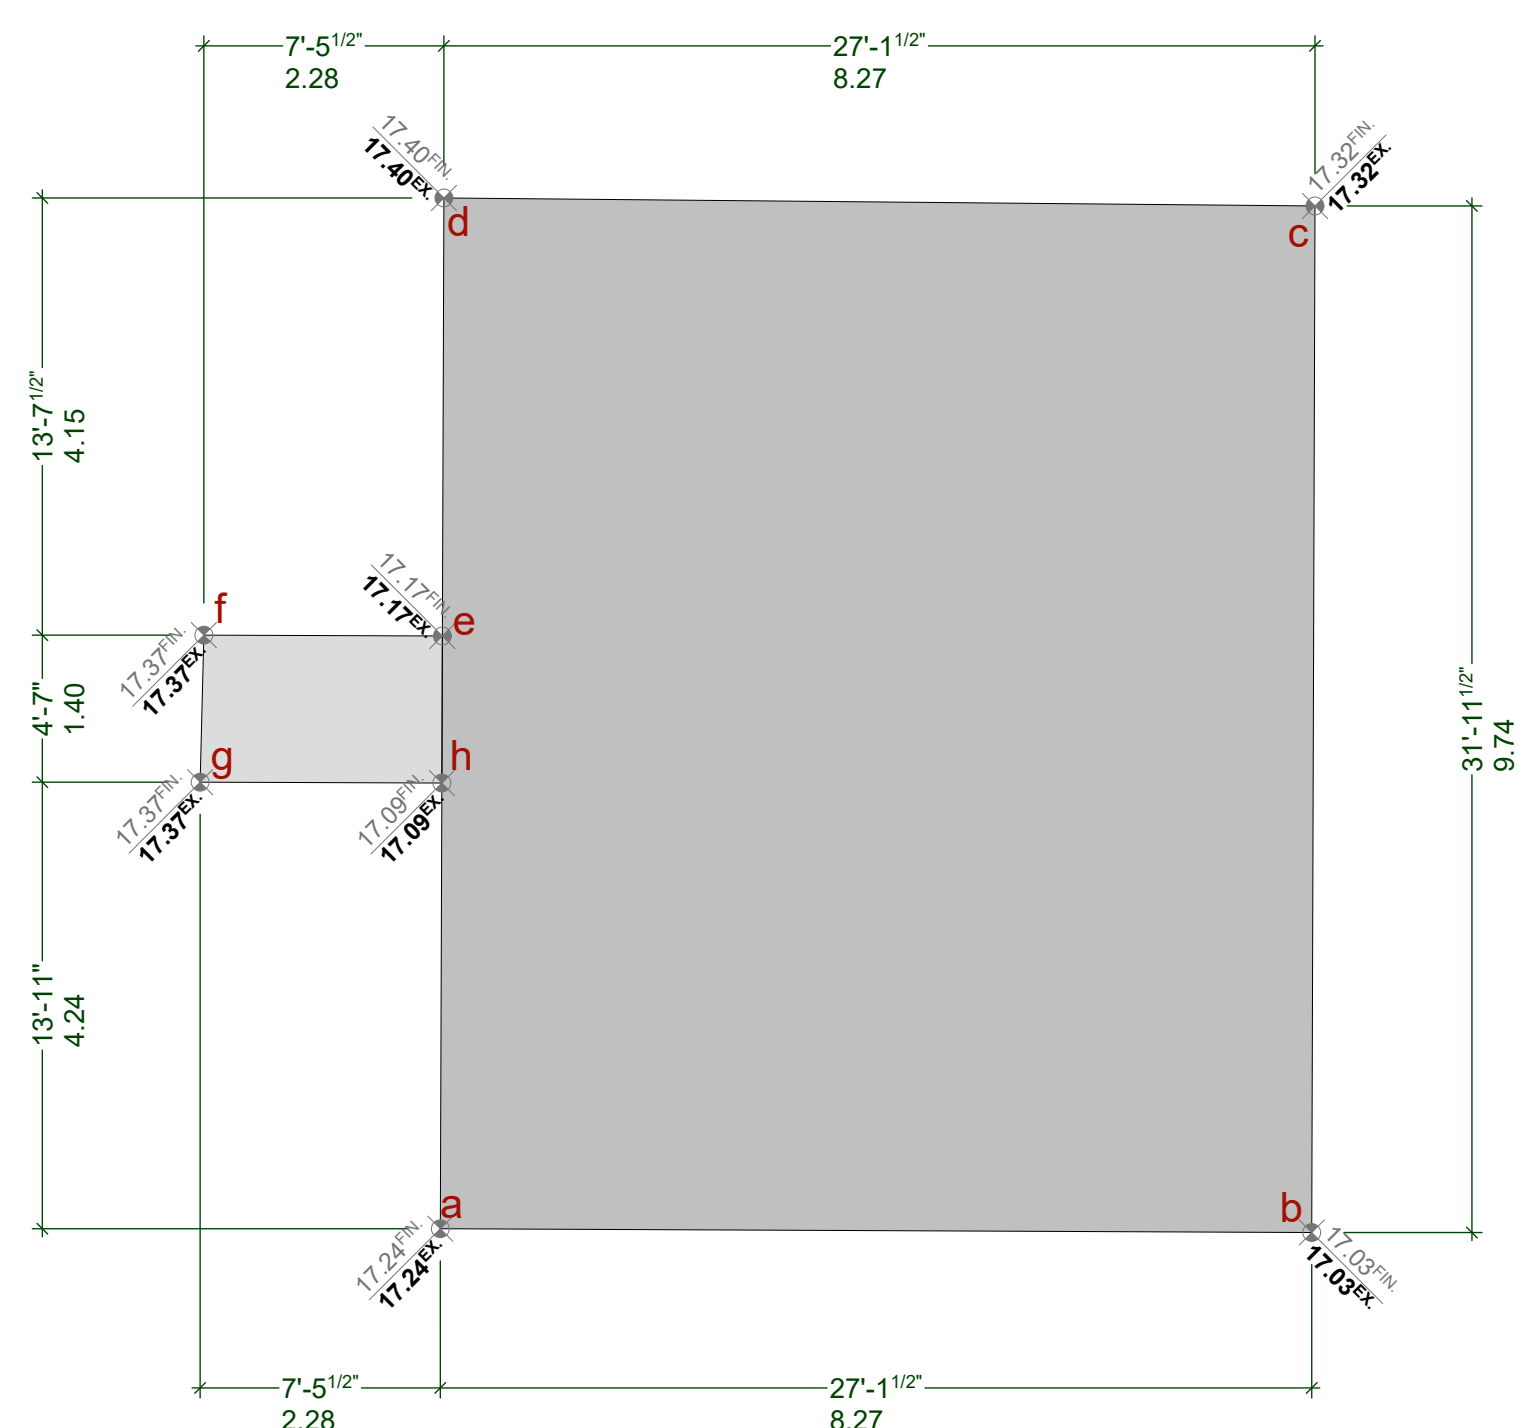

GRADE PLAN				
NOT TO SCALE				
Grade Points	Avg. Of Points	Distance Between	Totals	
a/b	17.24 + 17.03 /2 = 17.14	8.27	141.75	
b/c	17.03 + 17.32 /2 = 17.18	9.74	167.33	
c/d	17.32 + 17.40 /2 = 17.36	8.27	143.57	
d/e	17.40 + 17.17 /2 = 17.29	4.15	71.75	
e/f	17.17 + 17.37 /2 = 17.27	2.28	39.38	
f/g	17.37 + 17.37 /2 = 17.37	1.40	24.32	
g/h	17.37 + 17.09 /2 = 17.23	2.28	39.28	
h/a	17.09 + 17.24 /2 = 17.17	4.24	72.80	
Total:			700.18	
Permitter:			40.63	
AVG. GRADE =			17.23m	
ALLOWED HEIGHT (7.60m)			24.83m	
(17.23 + 7.60m)				

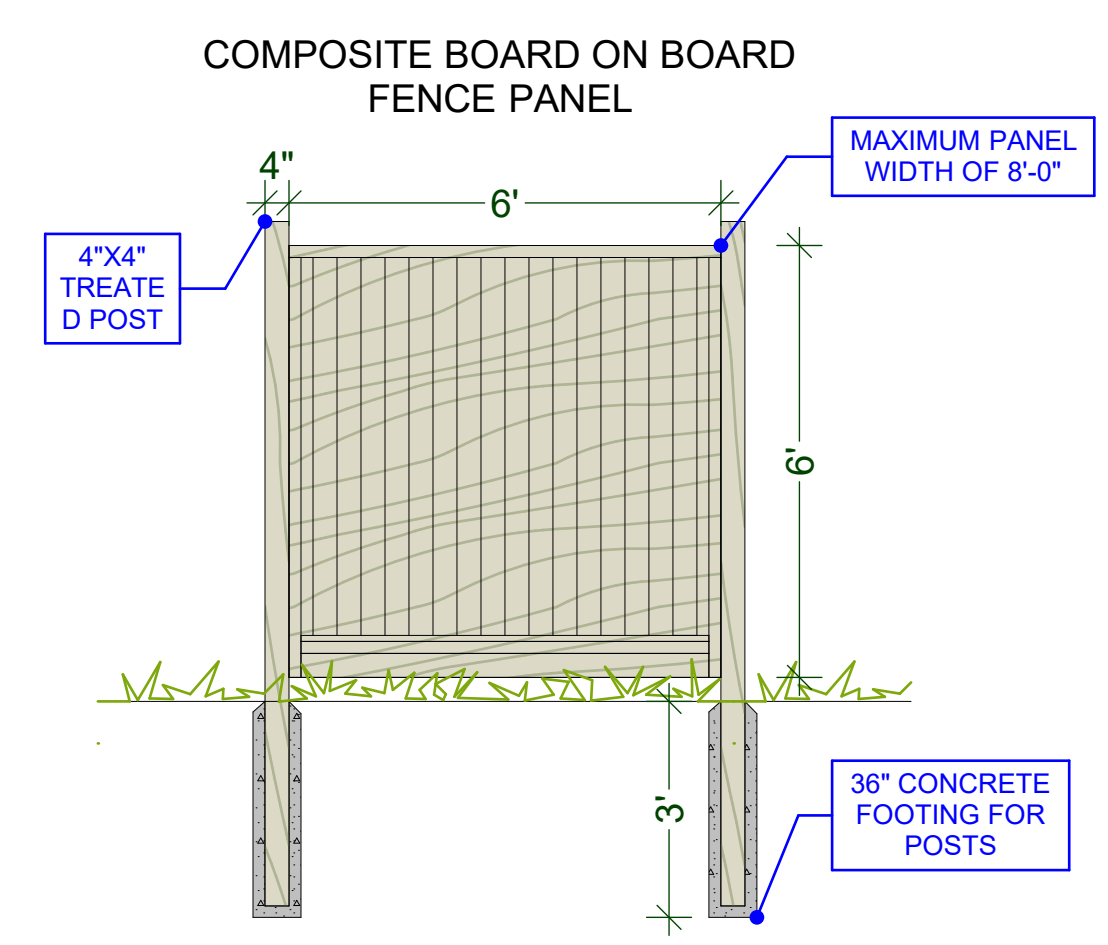

FENCE DETAIL
NOT TO SCALE

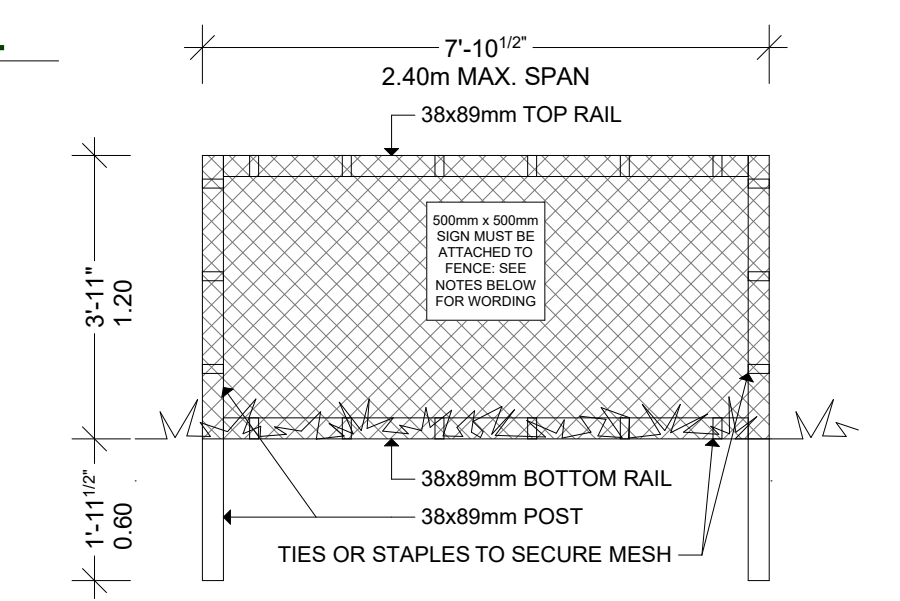

TREE PROTECTION FENCING:

NOTES:

1) FENCE WILL BE CONSTRUCTED USING 38 x 89 mm (2"x4") WOOD FRAME: TOP, BOTTOM AND POSTS*

2) ATTACH A 500mm X 500mm SIGN WITH THE FOLLOWING WORDING: **WARNING-HABITAT PROTECTION AREA.** THIS SIGN MUST BE AFFIXED ON EVERY FENCE OR AT LEAST EVERY 10 LINEAR METERS.

*IN ROCKY AREAS, METAL POSTS (T-BAR OR REBAR) DRILLED INTO ROCK WILL BE ACCEPTED

TREE PROTECTION FENCING
NOT TO SCALE

CUSTOMER: MARIA WEEKS

ADDRESS: 1905 LEE AVE.

LOT 4 PLAN 5969 SECTION 76 VICTORIA

DRAWING NAME: LANDSCAPE PLAN, FENCE DETAIL, AND GRADE PLANS

ISSUE DATE: FEB 16, 2020

DRAWING SCALE: SEE DRAWINGS

DRAWN BY: KYLE LEGGETT


JAVA DESIGNS

WHERE LINES ON PAPER BECOME WALLS ON SITE


PH 250.590.2468 FX 250.590.4577 www.javadesigns.ca

SHEET NUMBER

A2

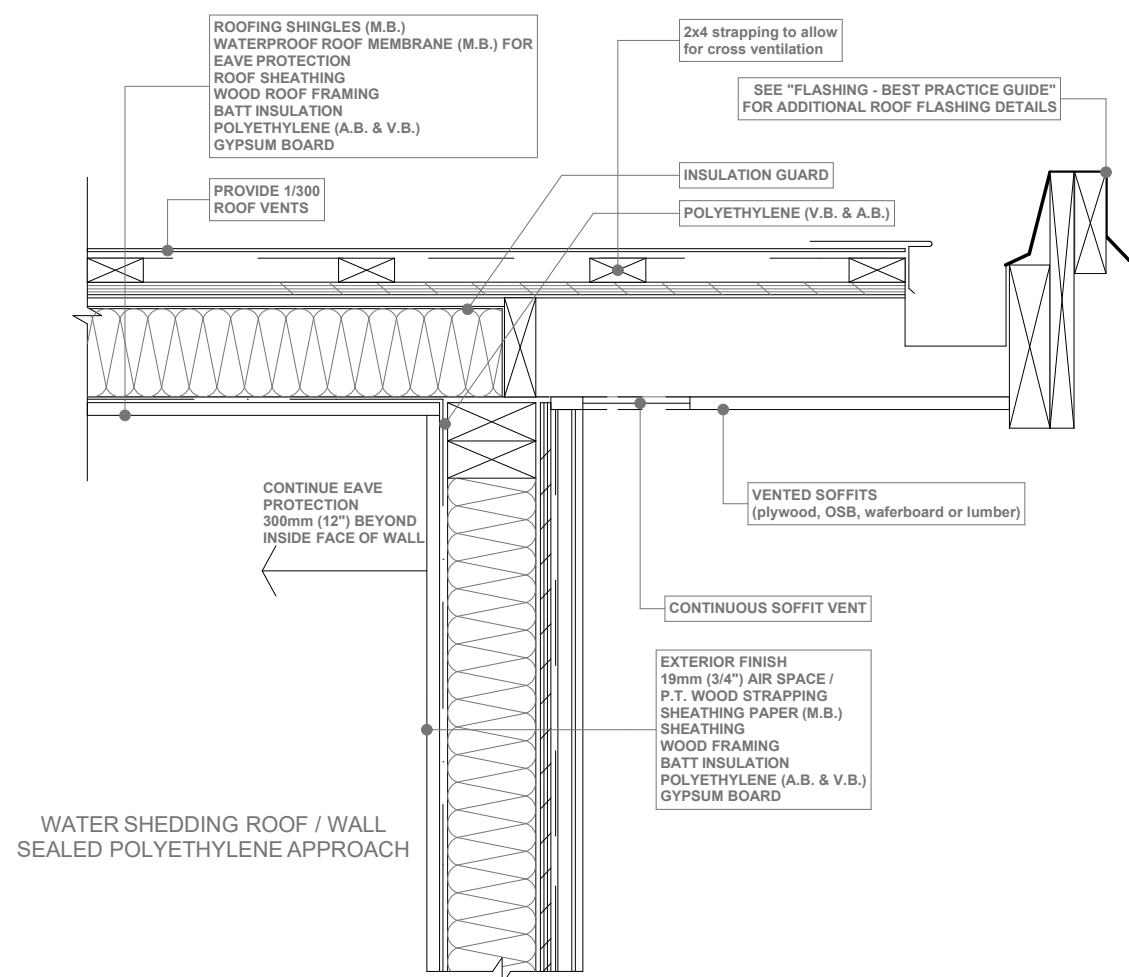

SOFFIT DETAIL
SCALE: 1" = 1' - 0"

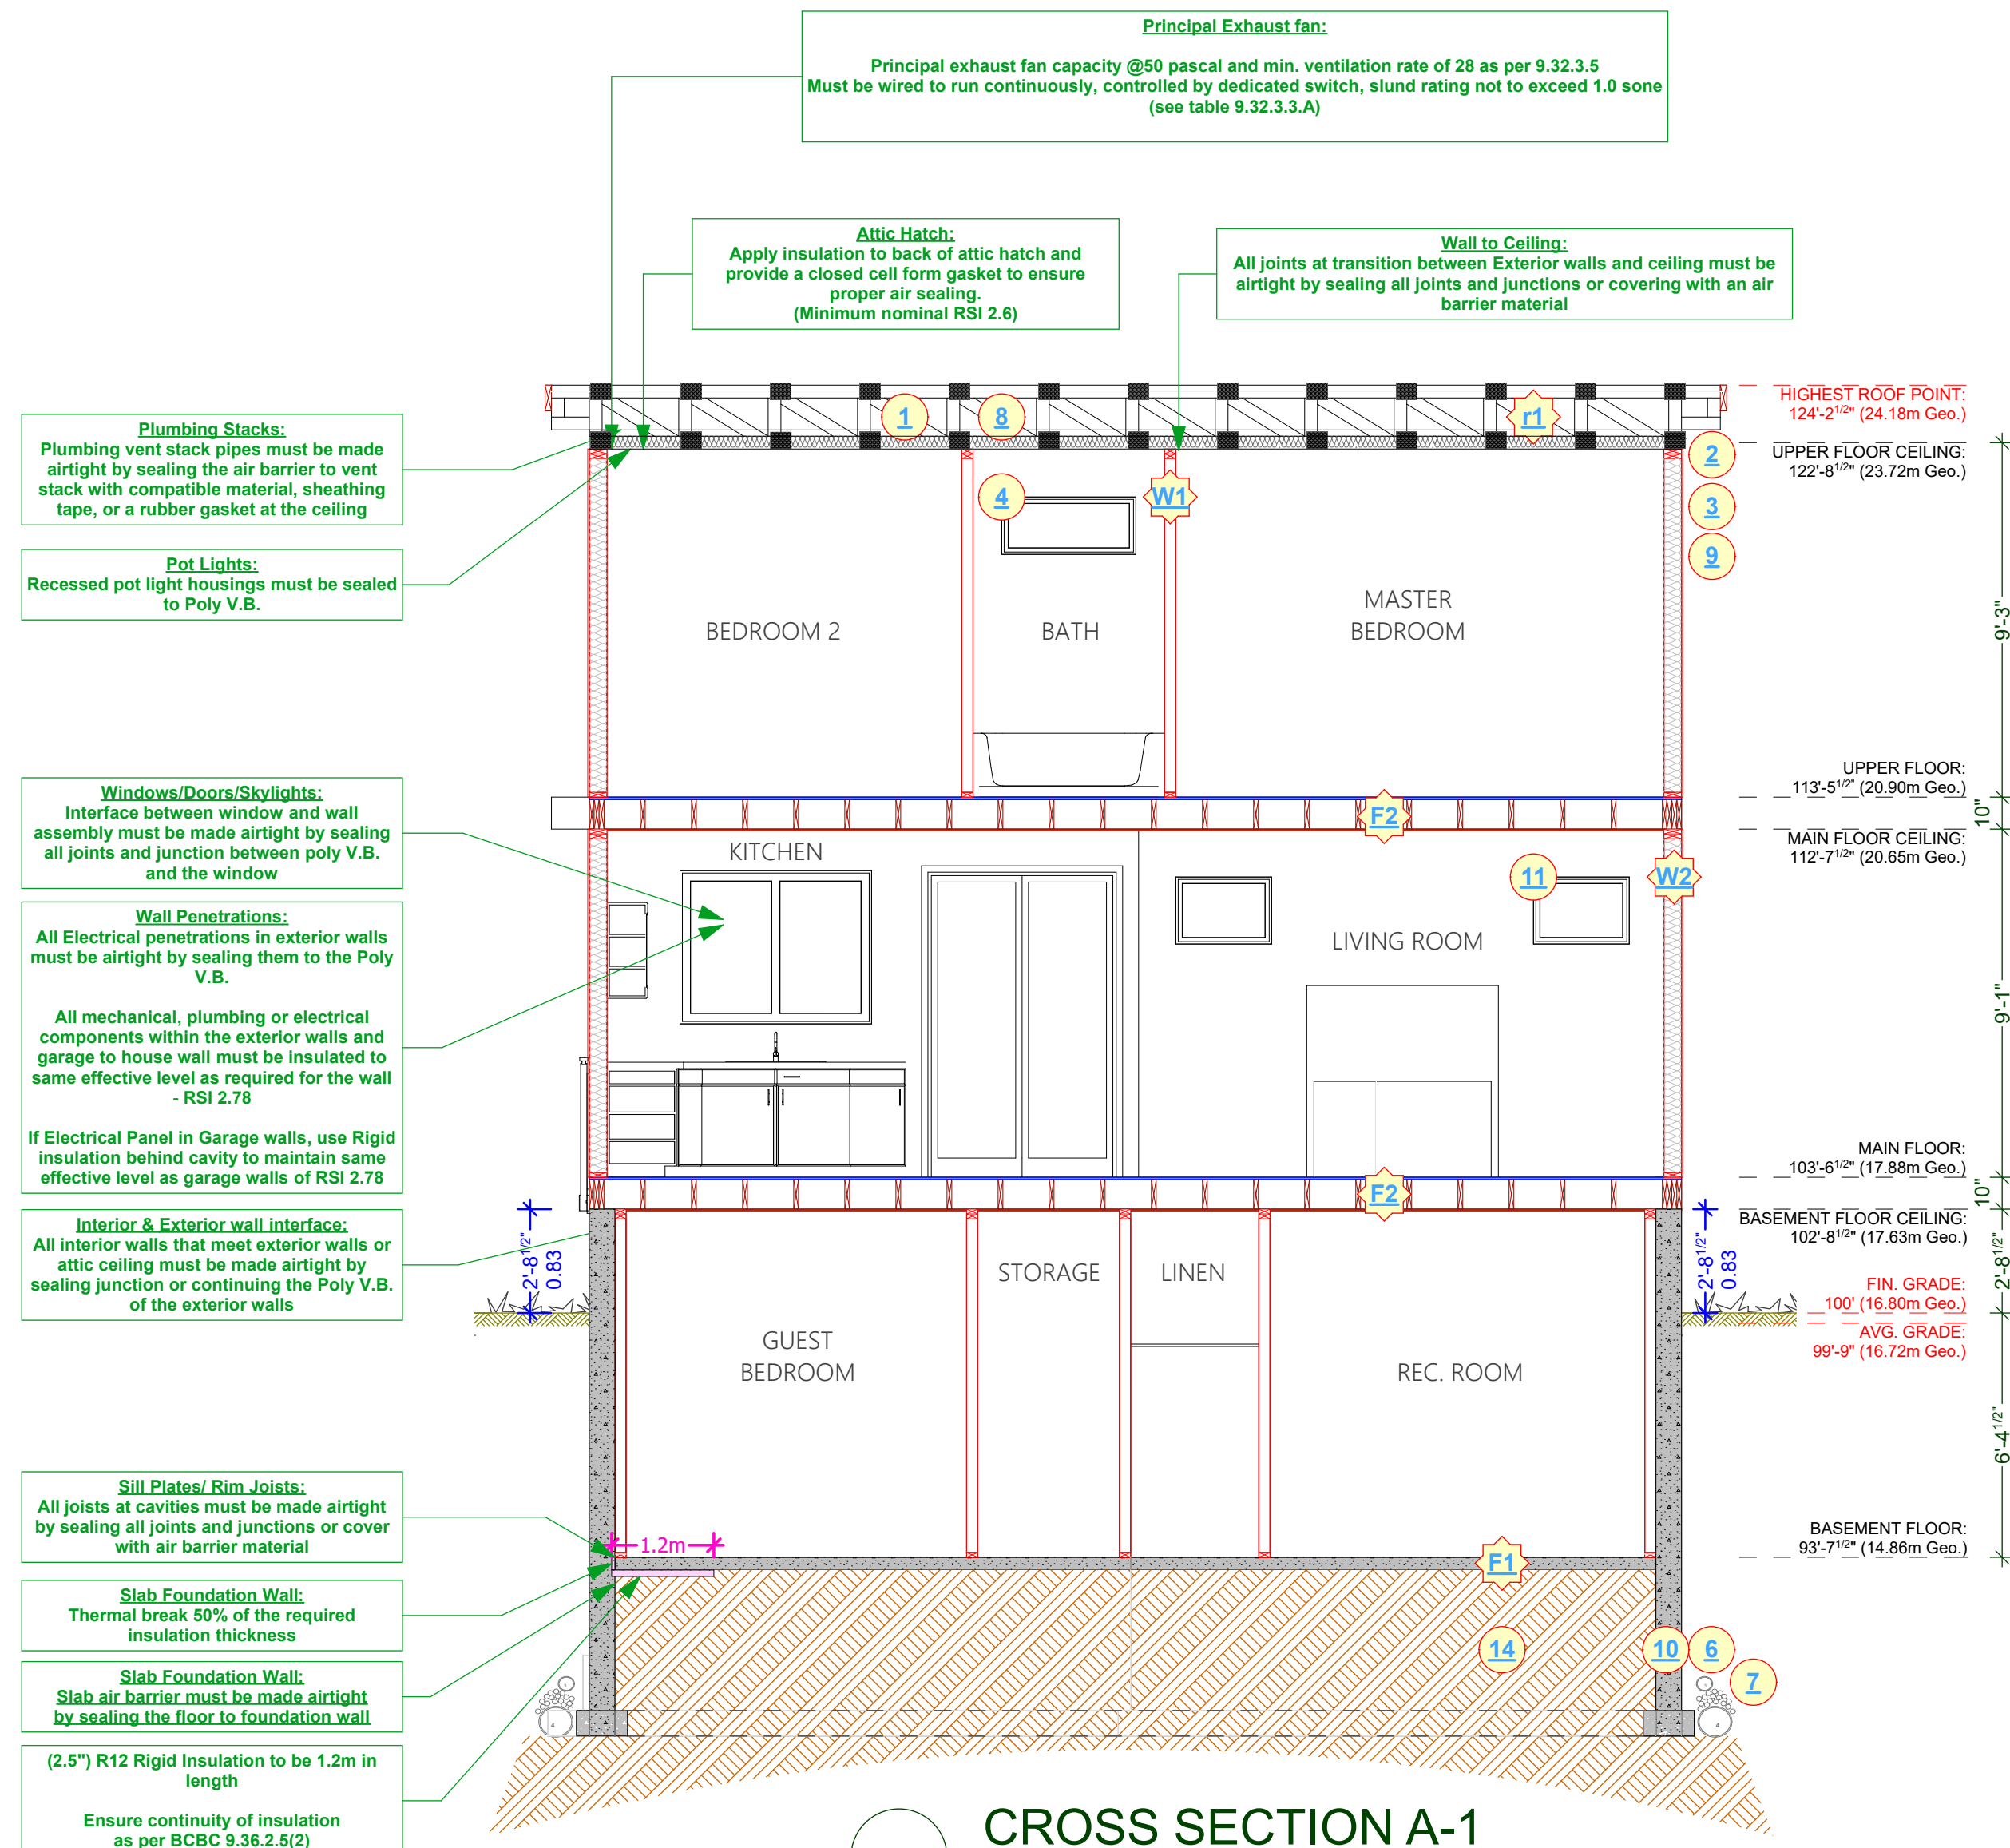

CROSS SECTION A-1

SCALE: 1/4" = 1' - 0"

HEAT SOURCE TO BE: DUCTLESS HEAT PUMP WITH HRV

EFFECTIVE R-VALUE FOR EXTERIOR WALLS AGAINST LOWER ROOF:	
Exterior Air Film	0.03
7/16" OSB Sheathing	0.11
R-22 Batt insulation	
2x6 Wood studs @ 16" O.C.	
$RSIp=100/[(23/1.19)+(77/3.87)]=$	
6 MIL Poly V.B.	2.55
1/2" Gypsum Board	0
Interior Air Film	0.08
	0.11
	RSI=2.88

EFFECTIVE R-VALUE FOR EXTERIOR WALLS ABOVE GRADE:	
Exterior Air Film	0.03
Fibre-Cement Siding	0.02
1/2" Rain Screen Air Cavity	0.15
Building Paper	0
7/16" OSB Sheathing	0.11
R-20 Batt insulation	
2x6 Wood studs @ 16" O.C.	2.36
$RSIp=100/[(23/1.19)+(77/3.34)]=$	
6 MIL Poly V.B.	0
1/2" Gypsum Board	0.08
Interior Air Film	0.11
	RSI=2.86

EFFECTIVE R-VALUE FOR FOUNDATION WALLS:	
Damp proofing	0
8" poured-in place concrete	2.11
(2.5") R12 Rigid Insulation	
	RSI=2.11

EFFECTIVE R-VALUE FLOOR OVER UNHEATED SPACE (OUTSIDE):	
Exterior Air Film	0.03
Aluminum Soffit	0.00
3/4" Sheathing	0.161
R28 Batt insulation	
2x10 Wood Joists @ 16" O.C.	
$RSIp=100/[(13/2.0)+(87/4.93)]=$	
3/4" Sheathing	4.16
Interior Air Film	0.161
	0.16
	RSI=4.67

EFFECTIVE R-VALUE CEILING BELOW ATTIC (TRUSSES):	
Built-up Torch-on Roofing	0.06
1/2" Sheathing	0
Attic air film	0.03
R40 blown fiberglass insulation above truss cord	5.38
Wood trusses @ 24" O.C.	1.47
$RSIp=100/[(11/0.76)+(89/1.67)]=$	
6 MIL Poly V.B.	0
1/2" Gypsum Board	0.08
Interior Air Film	0.12
	RSI=7.14

CONSTRUCTION NOTES:

- R40 insulation, 6 mil poly V.B., 1/2" ceiling board. RSI VALUE OF 6.91
- Continuous gutters
- Aluminum gutters and non-vented soffits - roof overhangs as per plans
- All windows vinyl, supply rain pan under, rainscreen as per BCBC. Windows in doors to be safety glass
- Stairs: 7 5/8" rise, 10.04" tread, 1" nosing with continuous handrail. NOT SHOWN
- Provide drains to perimeter system
- 4" drain tile with 6" rock over
- Provide roof vents: vent 1/150 using Shinglevent II Ridge Vent
- Eave protection to 12" beyond heated wall
- 8" concrete wall on 8"x16" concrete footings - 2#4 bar continuous - R12 rigid insulation - 2 coats damp proofing
- Caulk over and around all exterior openings
- 10" X 10" post saddle on 8" pilaster 2'x2' concrete footing. NOT SHOWN
- 42" non climbable continuous handrail. NOT SHOWN
- Undisturbed non-organic soil

ALL WINDOWS MUST COMPLY WITH BCBC AND NAFS REQUIREMENTS
MUST BE CLEARLY LABELED ON ALL WINDOW UNITS UPON INSTALLATION FOR INSPECTION. -ONE EXTERIOR DOOR IS PERMITTED TO HAVE A HIGHER U-VALUE OF 2.6, ALL OTHERS MUST HAVE U-VALUE LESS THEN 1.80 (AS PER TABLE 9.36.2.7.A) -GARAGE VEHICULAR DOORS MUST BE MINIMUM NOMINAL RSI OF 1.1

CONSTRUCTION ASSEMBLIES:

- 4" concrete floor on 6 mil poly V.B. compacted granular fill
- 2x10 floor joist 16" O.C. typ. nail and glue 3/4" T&G plywood X bridging @ 8" O.C. typ.
- Ply torch-on roofing, 7/16" O.S.B. (or 1/2" plywood), 2x4 strapping to allow cross ventilation, 2x12 roof joists @ 24" O.C. typ. R28 insulation, 6 mil. poly V.B. 1/2" GWB
- 2x4 framing 16" O.C. typ. 1/2" GWB finish throughout
- Exterior finish, 3/4" air space, pressure treated strapping, 2 layers 30 min. building paper, 1/2" sheathing, 2x6 studs at 16" O.C., R-20 batt insulation, 6 mil. poly V.B., 1/2" GWB. (See elevations)

ADD INTERCONNECTED PHOTO-ELECTRIC SMOKE ALARM CONFORMING TO ARTICLE 9.37.2.19. DWELLING UNITS TO BE SEPARATED FROM EACH OTHER BY A FIRE SEPARATION HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 30 min. AS PER 9.37.2.15.(b)

ALL POT LIGHT CAVITIES IN CEILINGS, PLUMBING BOXES, FANS, ELECTRICAL PANELS... IN PARTY WALLS TO BE COMPLETELY SEALED AND FIRE RATED WITH TYPE 'X' DRYWALL

CUSTOMER:
MARIA WEEKS

ADDRESS:
1905 LEE AVE.
LOT 4 PLAN 5969 SECTION 76 VICTORIA

DRAWING NAME:
CROSS SECTION A-1 AND
SOFFIT DETAIL


ISSUE DATE:
FEB 16, 2020

DRAWN BY:
KYLE LEGGETT

JAVA DESIGNS
WHERE LINES ON PAPER BECOME WALLS ON SITE
PH 250.590.2468 FX 250.590.4577 www.javadesigns.ca


SHEET
NUMBER

A3

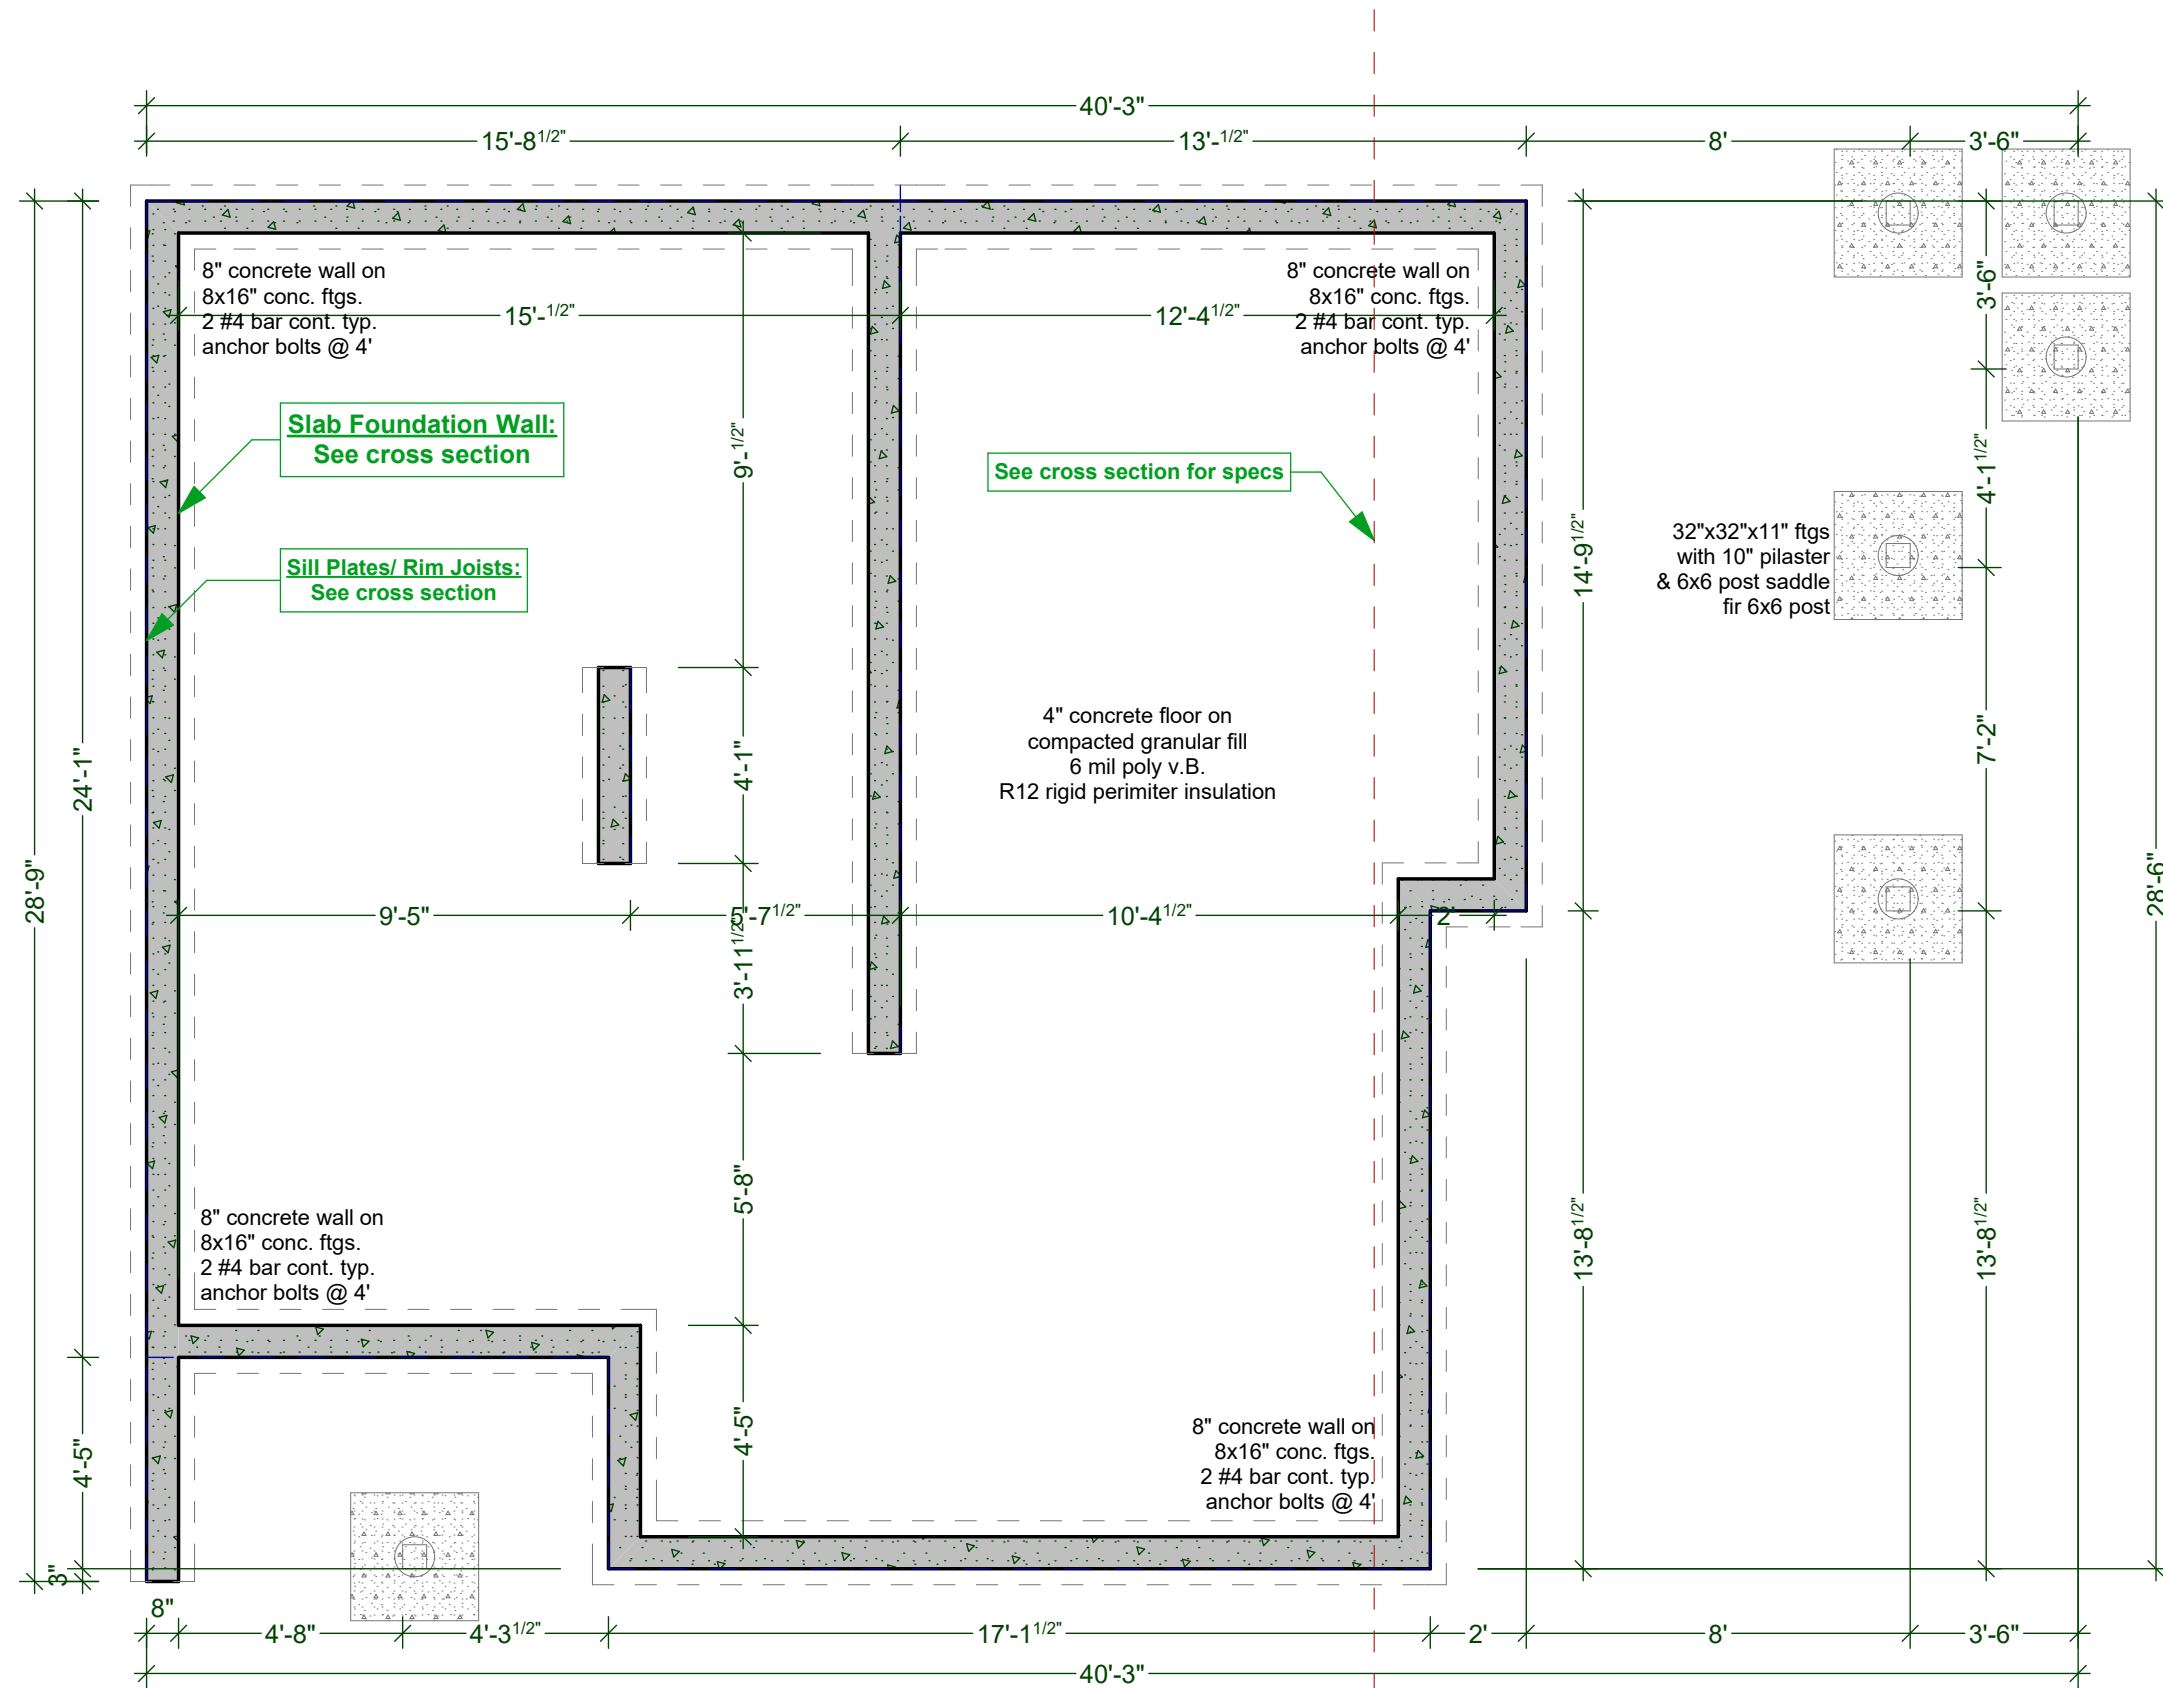

FOUNDATION PLAN (ON SLAB)


SCALE: 1/4" = 1' - 0"

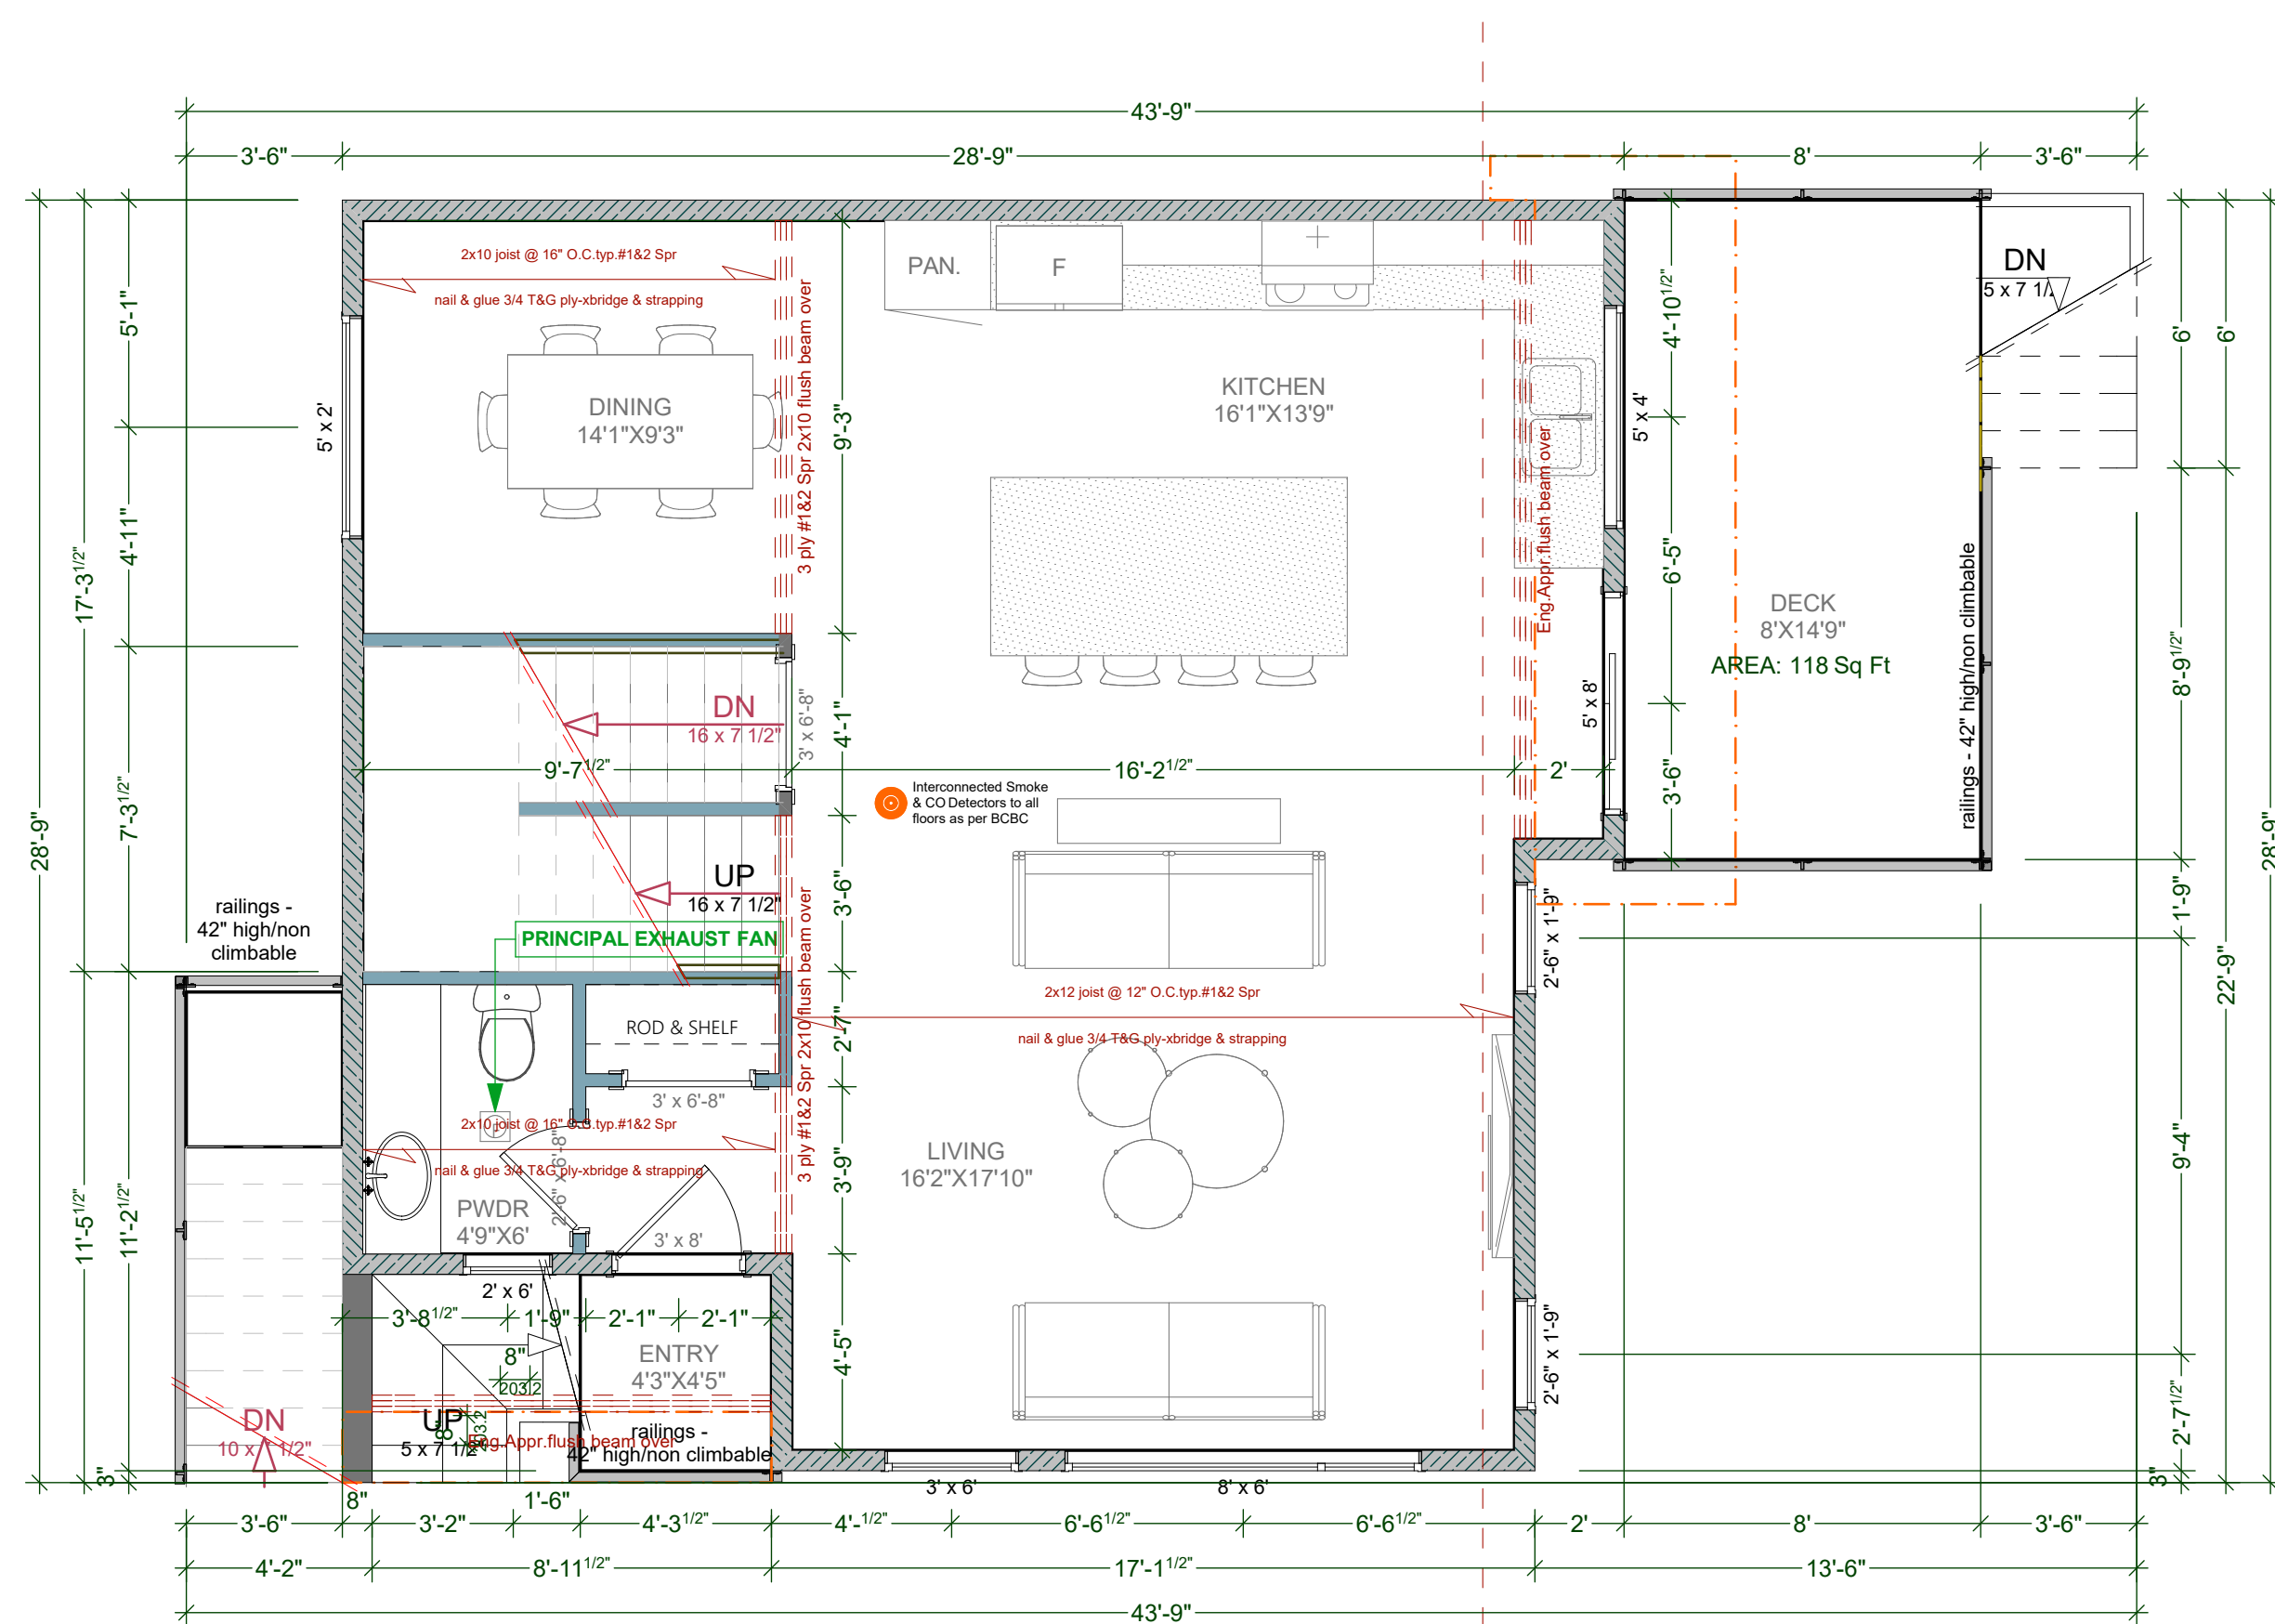

MAIN FLOOR PLAN (9'-0 3/4" WALLS)

SCALE: 1/4" = 1' - 0"


MAIN FLOOR AREA: 697.93 Sq Ft (64.84 SQ. M)

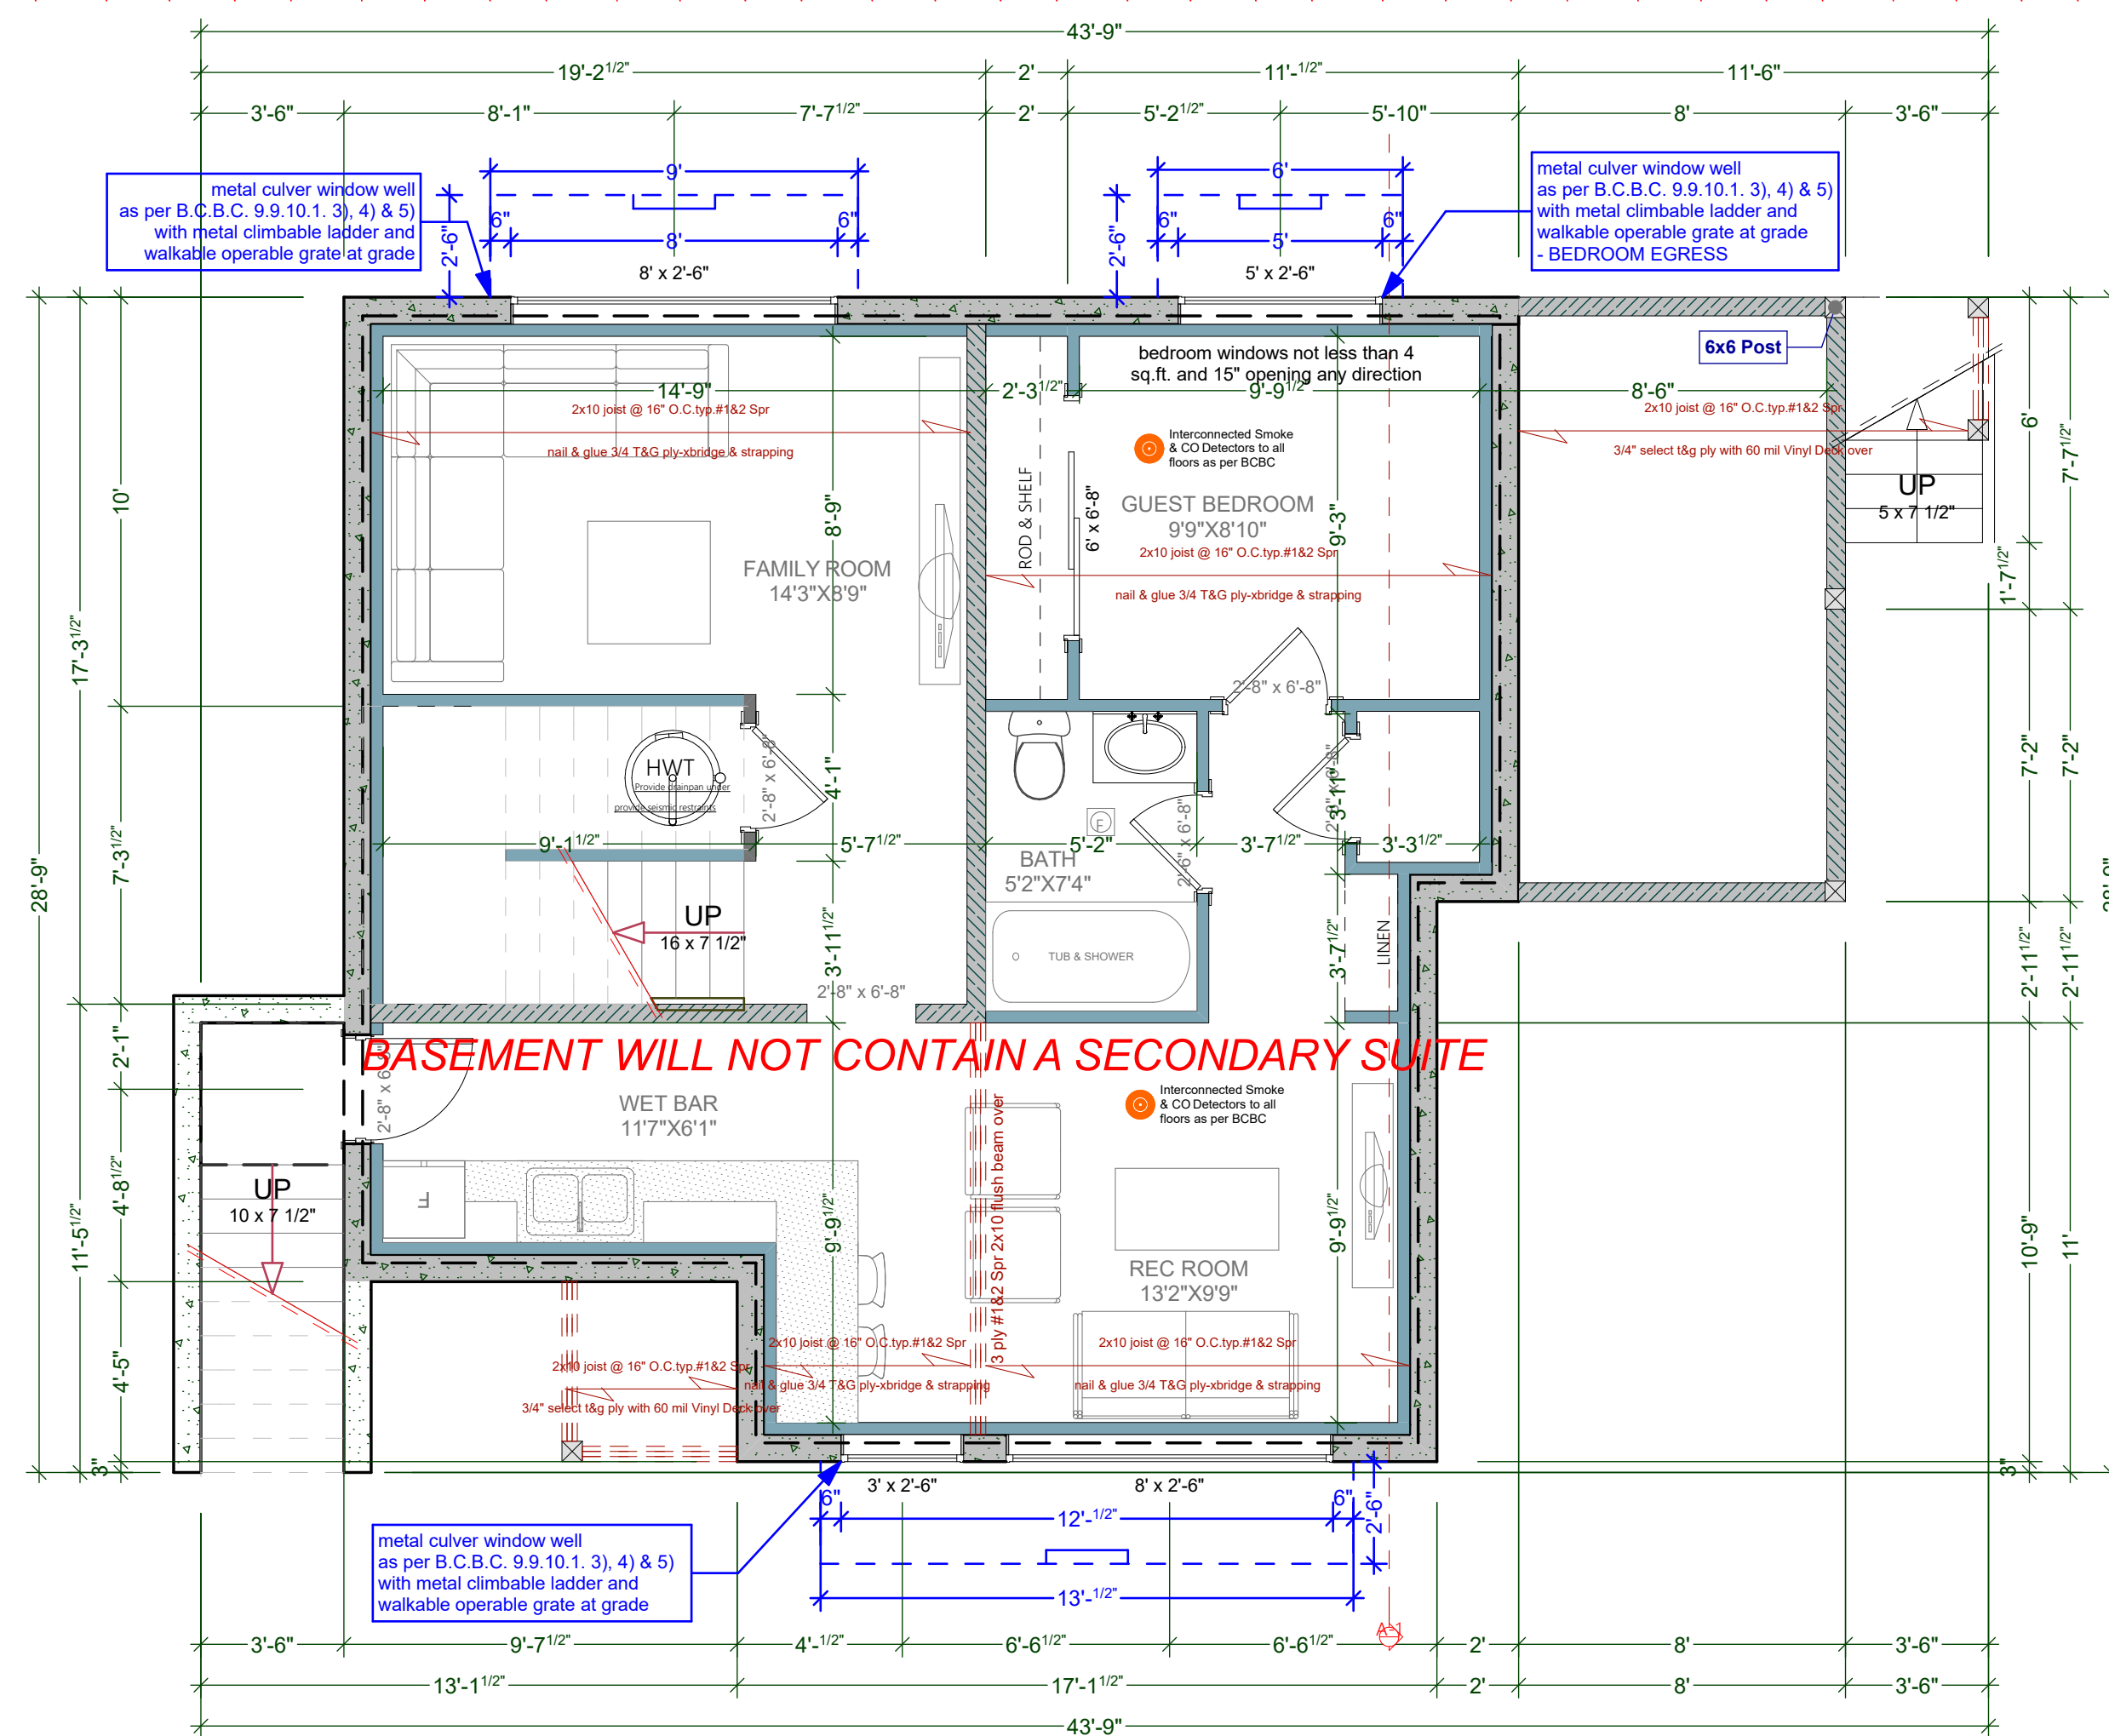

BASEMENT FLOOR PLAN (9'-0 3/4" WALLS)

SCALE: 1/4" = 1' - 0"

BASEMENT FLOOR AREA: 608.48 Sq Ft (56.53 SQ. M)

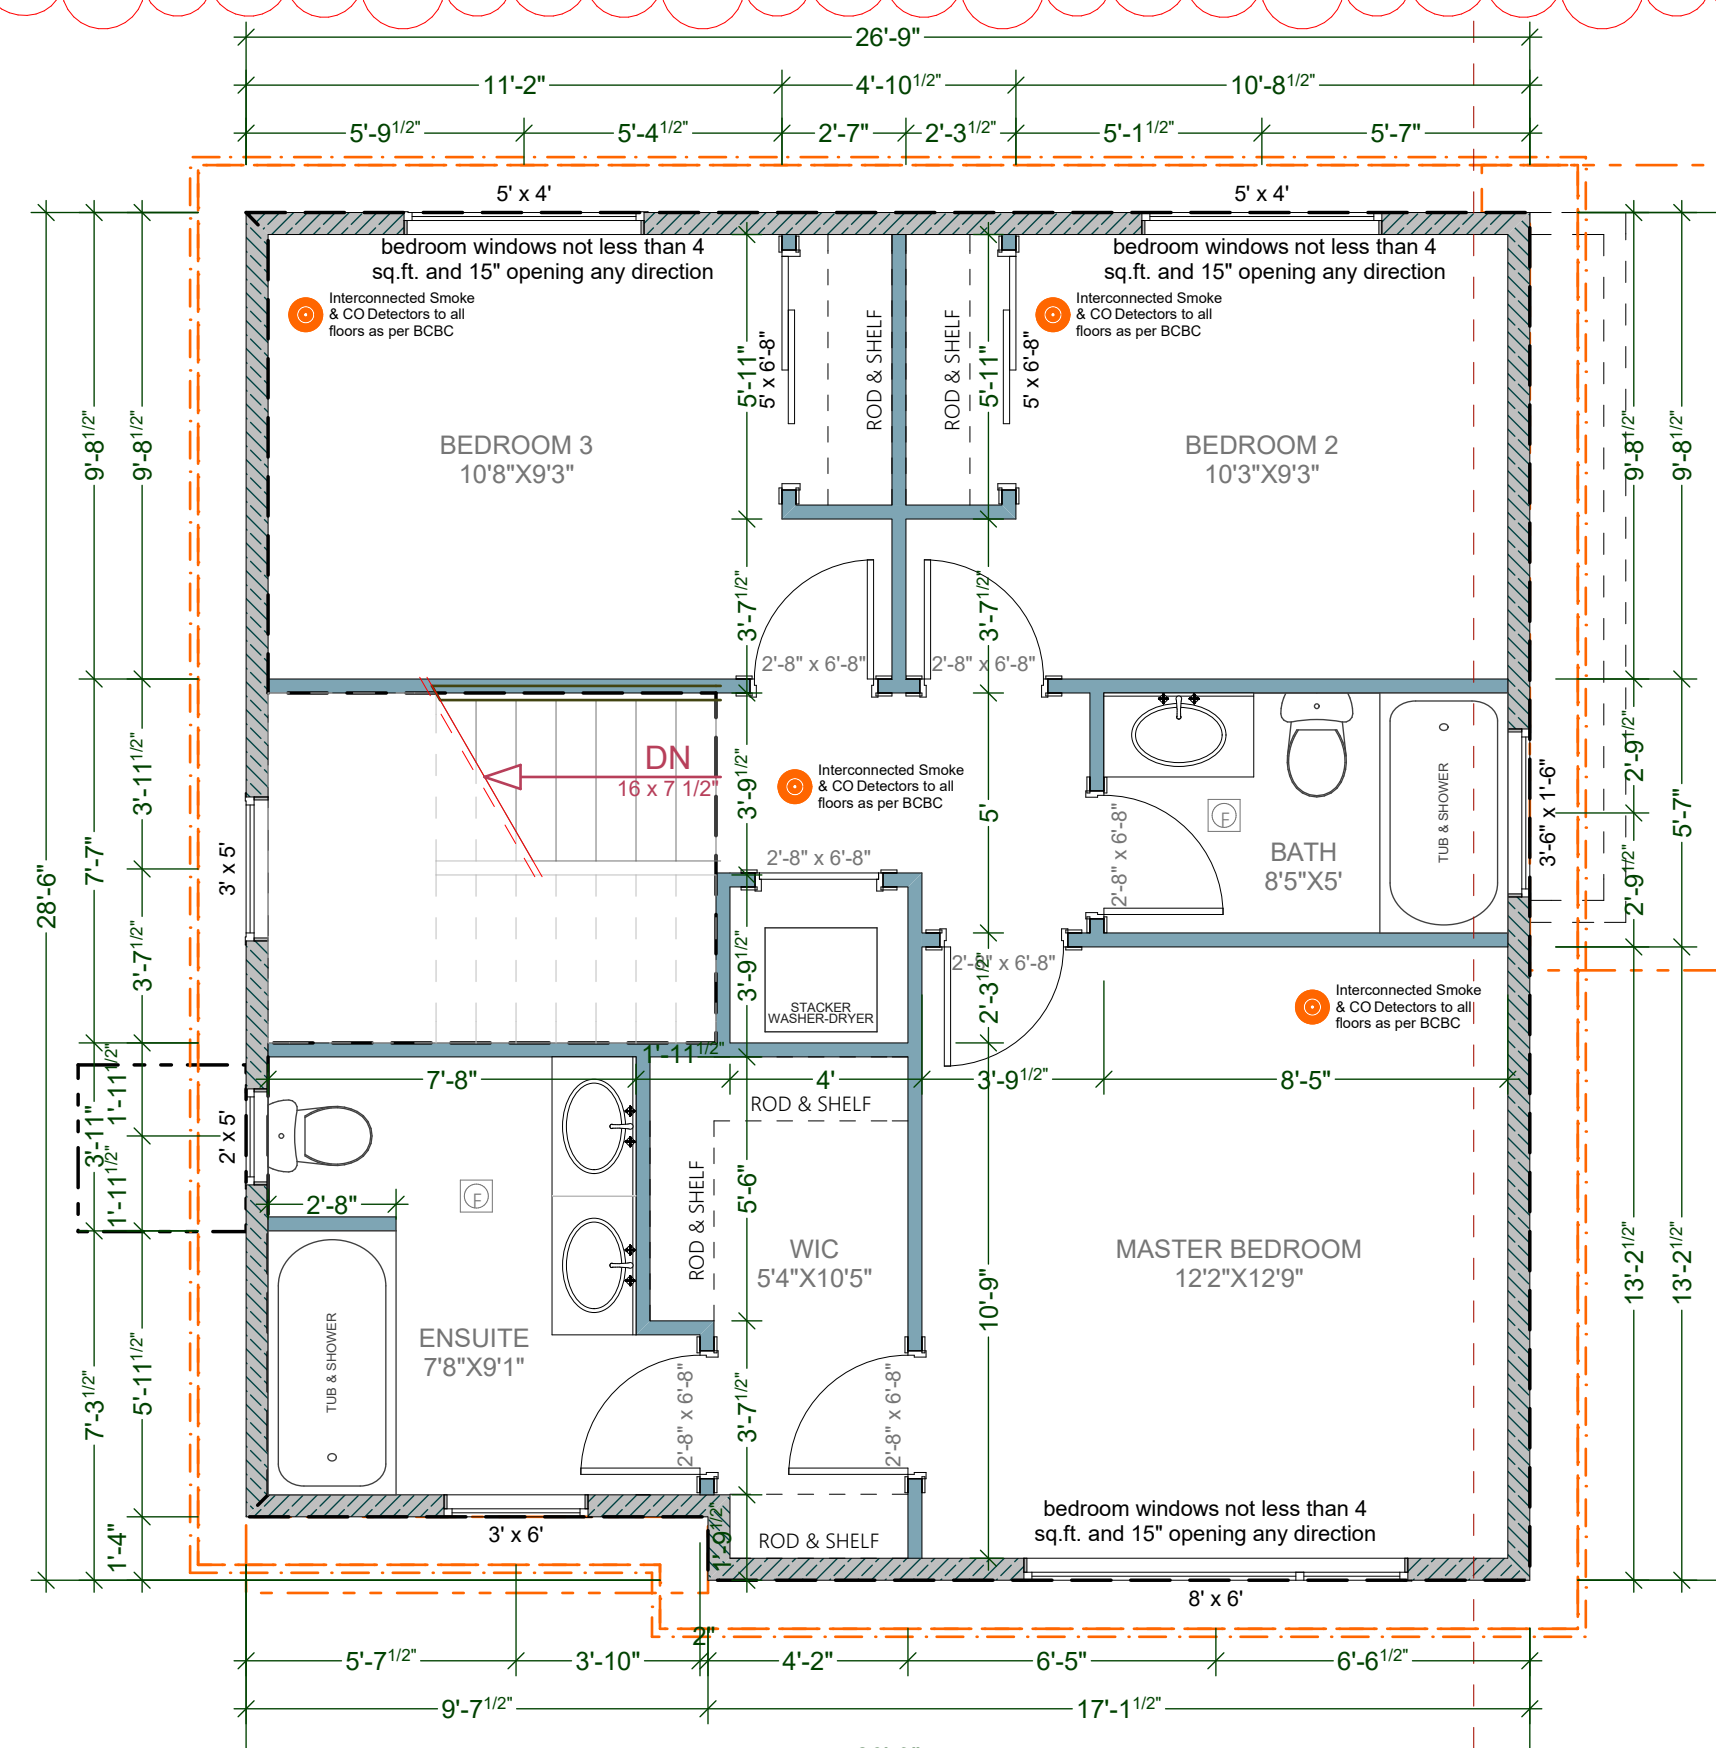

UPPER FLOOR PLAN (9'-0 3/4" WALLS)

SCALE: 1/4" = 1' - 0"

UPPER FLOOR AREA: 699.85 Sq Ft (65.02 SQ. M)





CUSTOMER:
MARIA WEEKS

ADDRESS:
1905 LEE AVE.
LOT 4 PLAN 5969 SECTION 76 VICTORIA

DRAWING NAME:
FOUNDATION, BASEMENT, MAIN
AND UPPER FLOOR PLANS

ISSUE DATE:
FEB 16, 2020

DRAWN BY:
KYLE LEGGETT

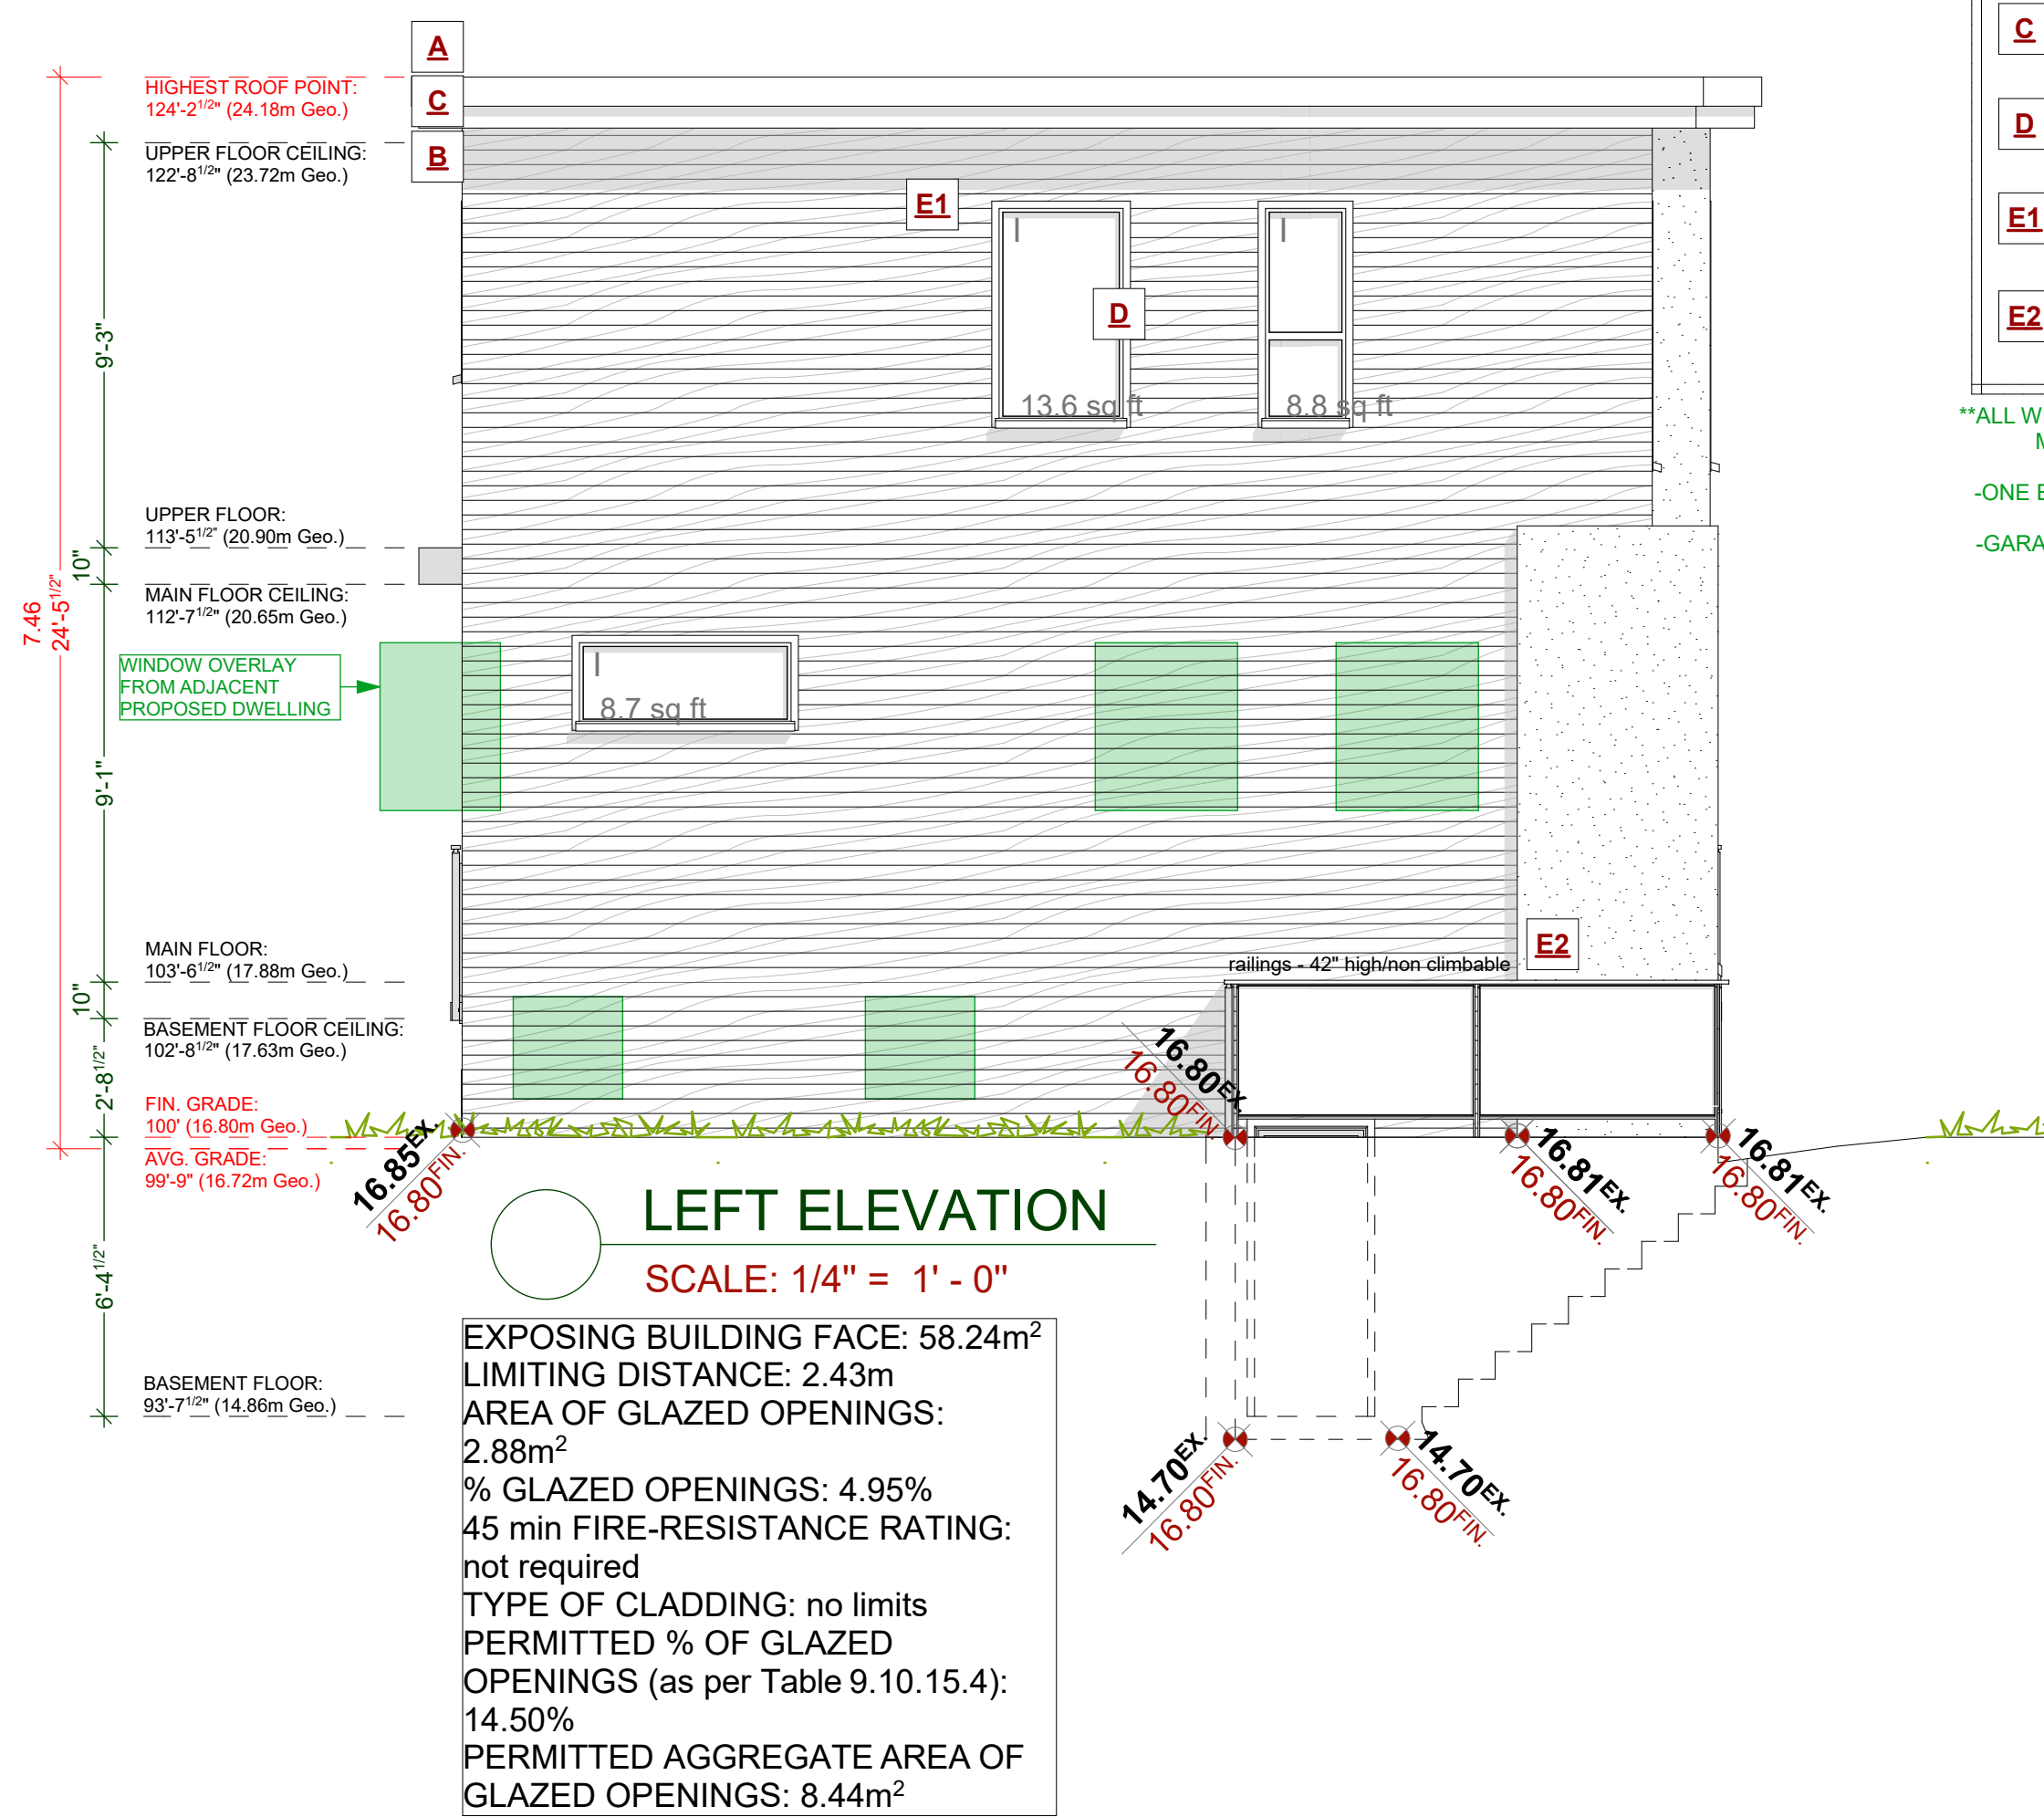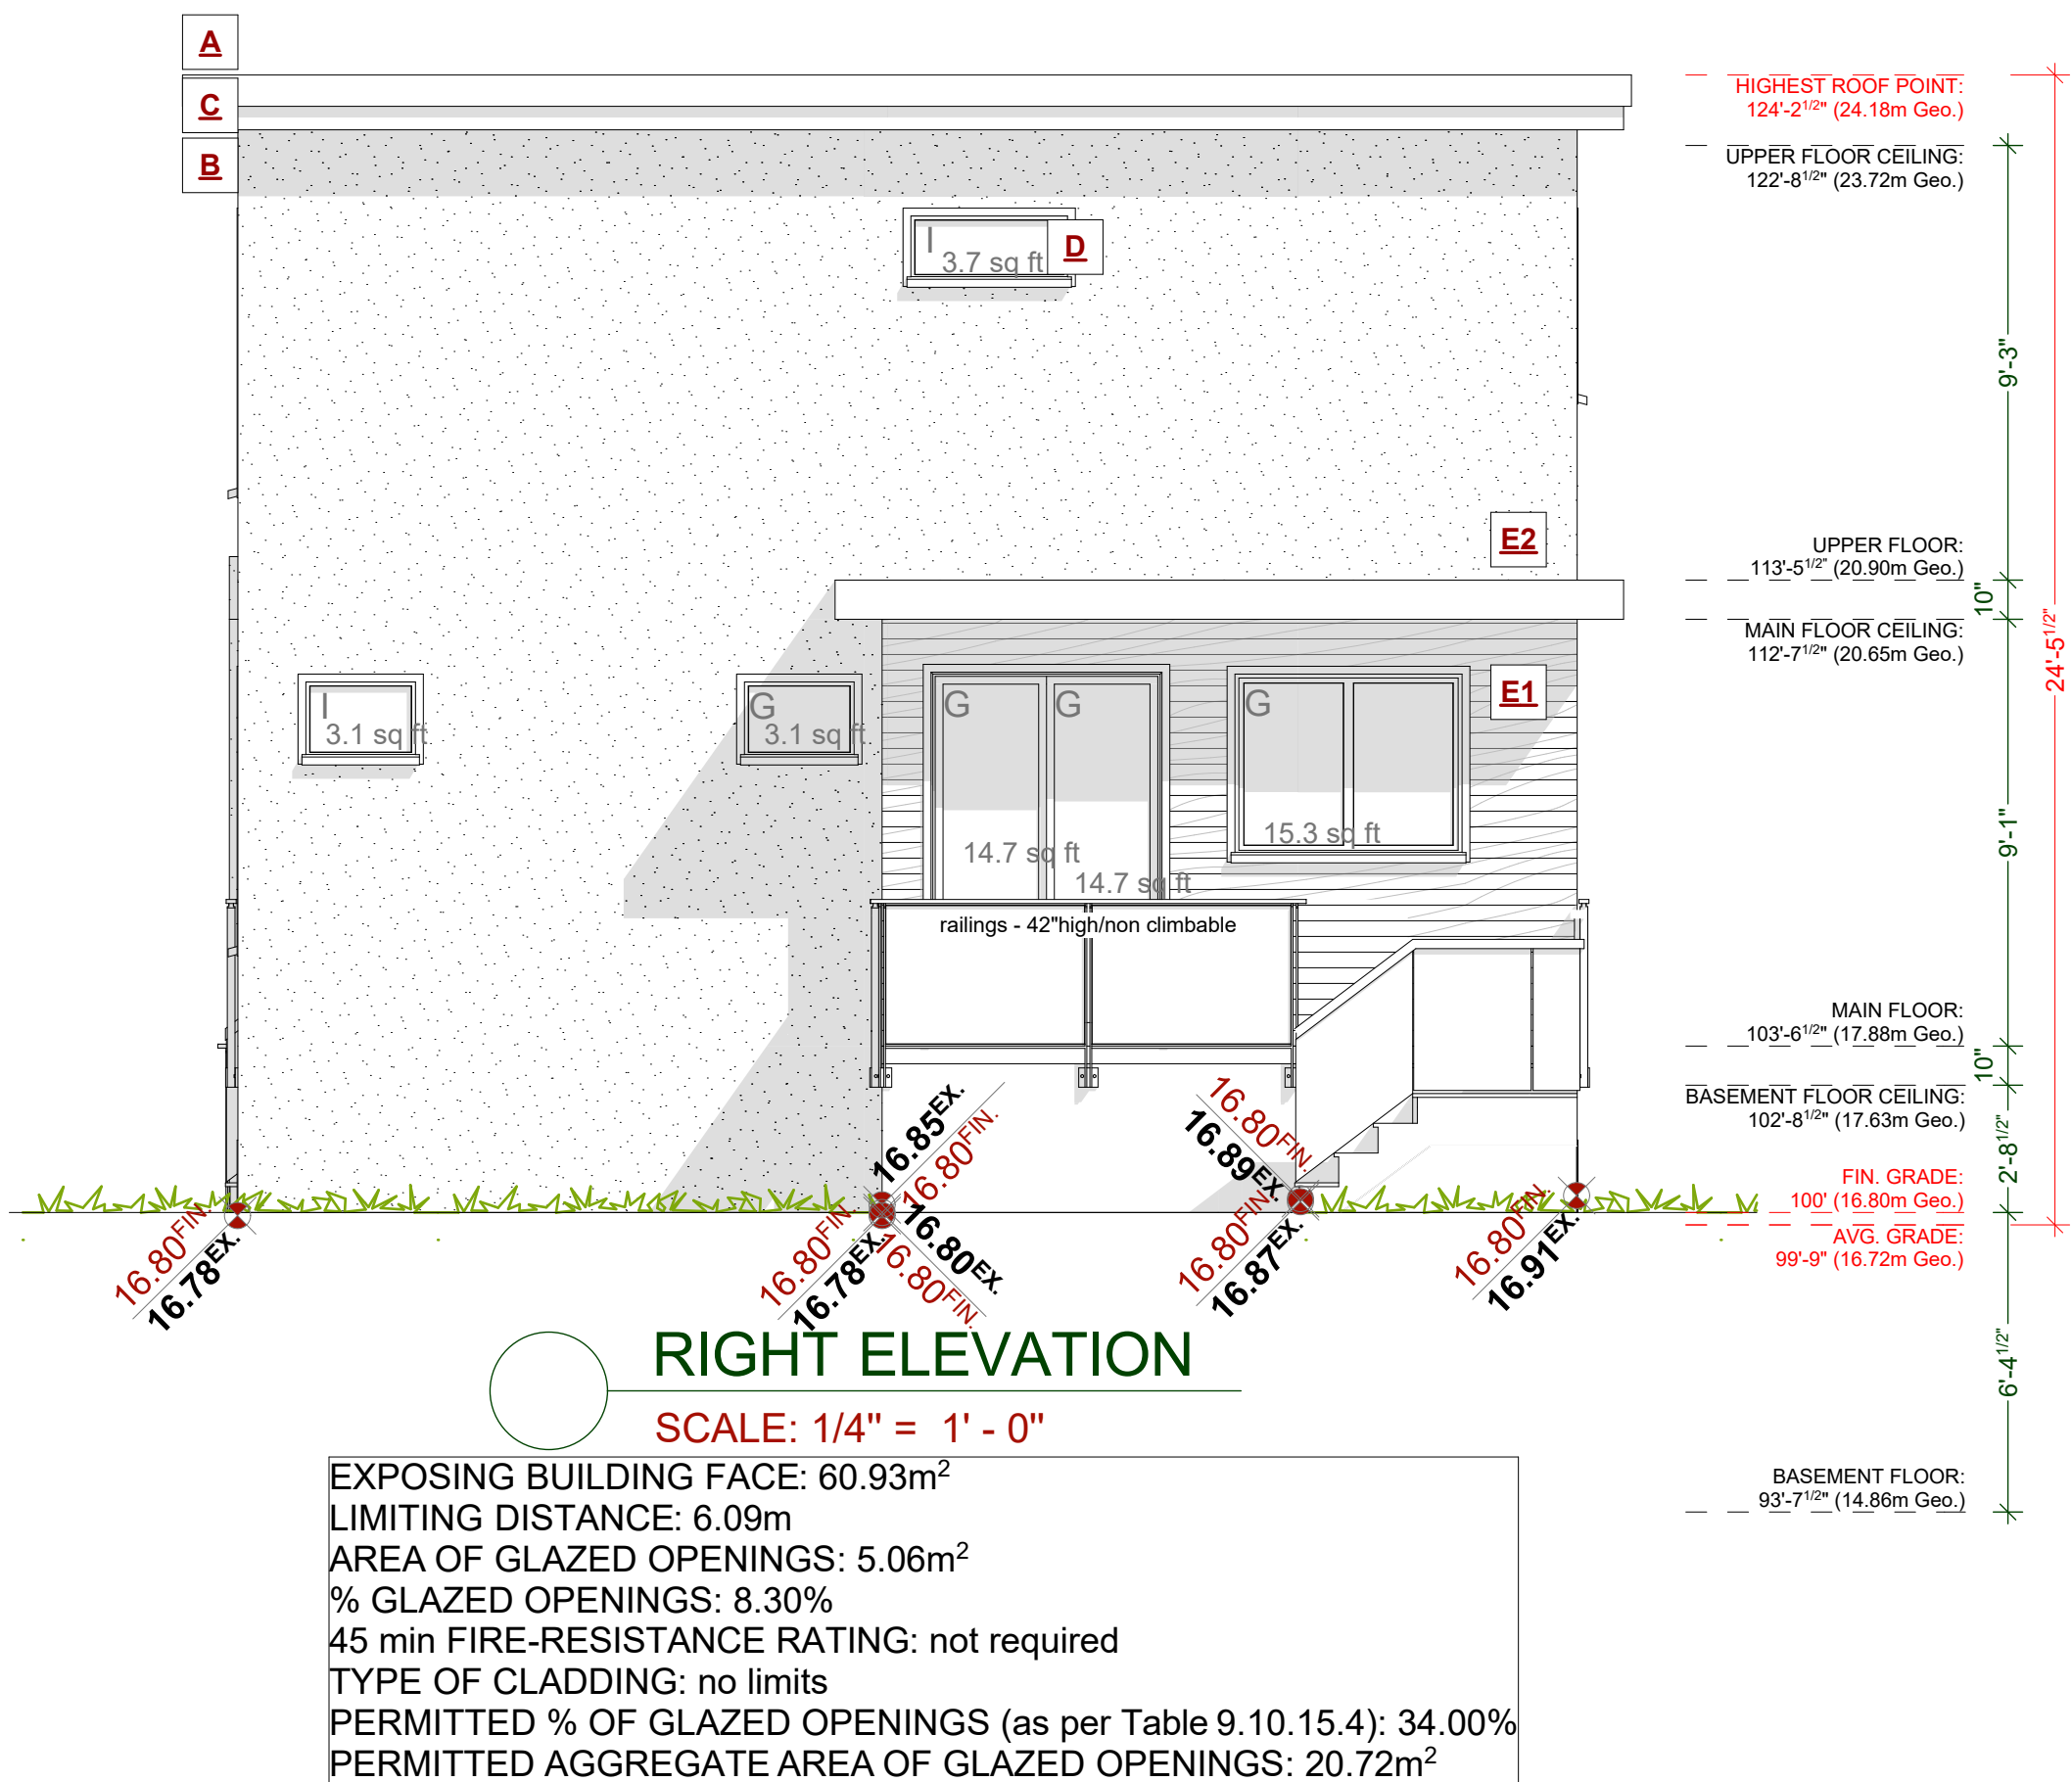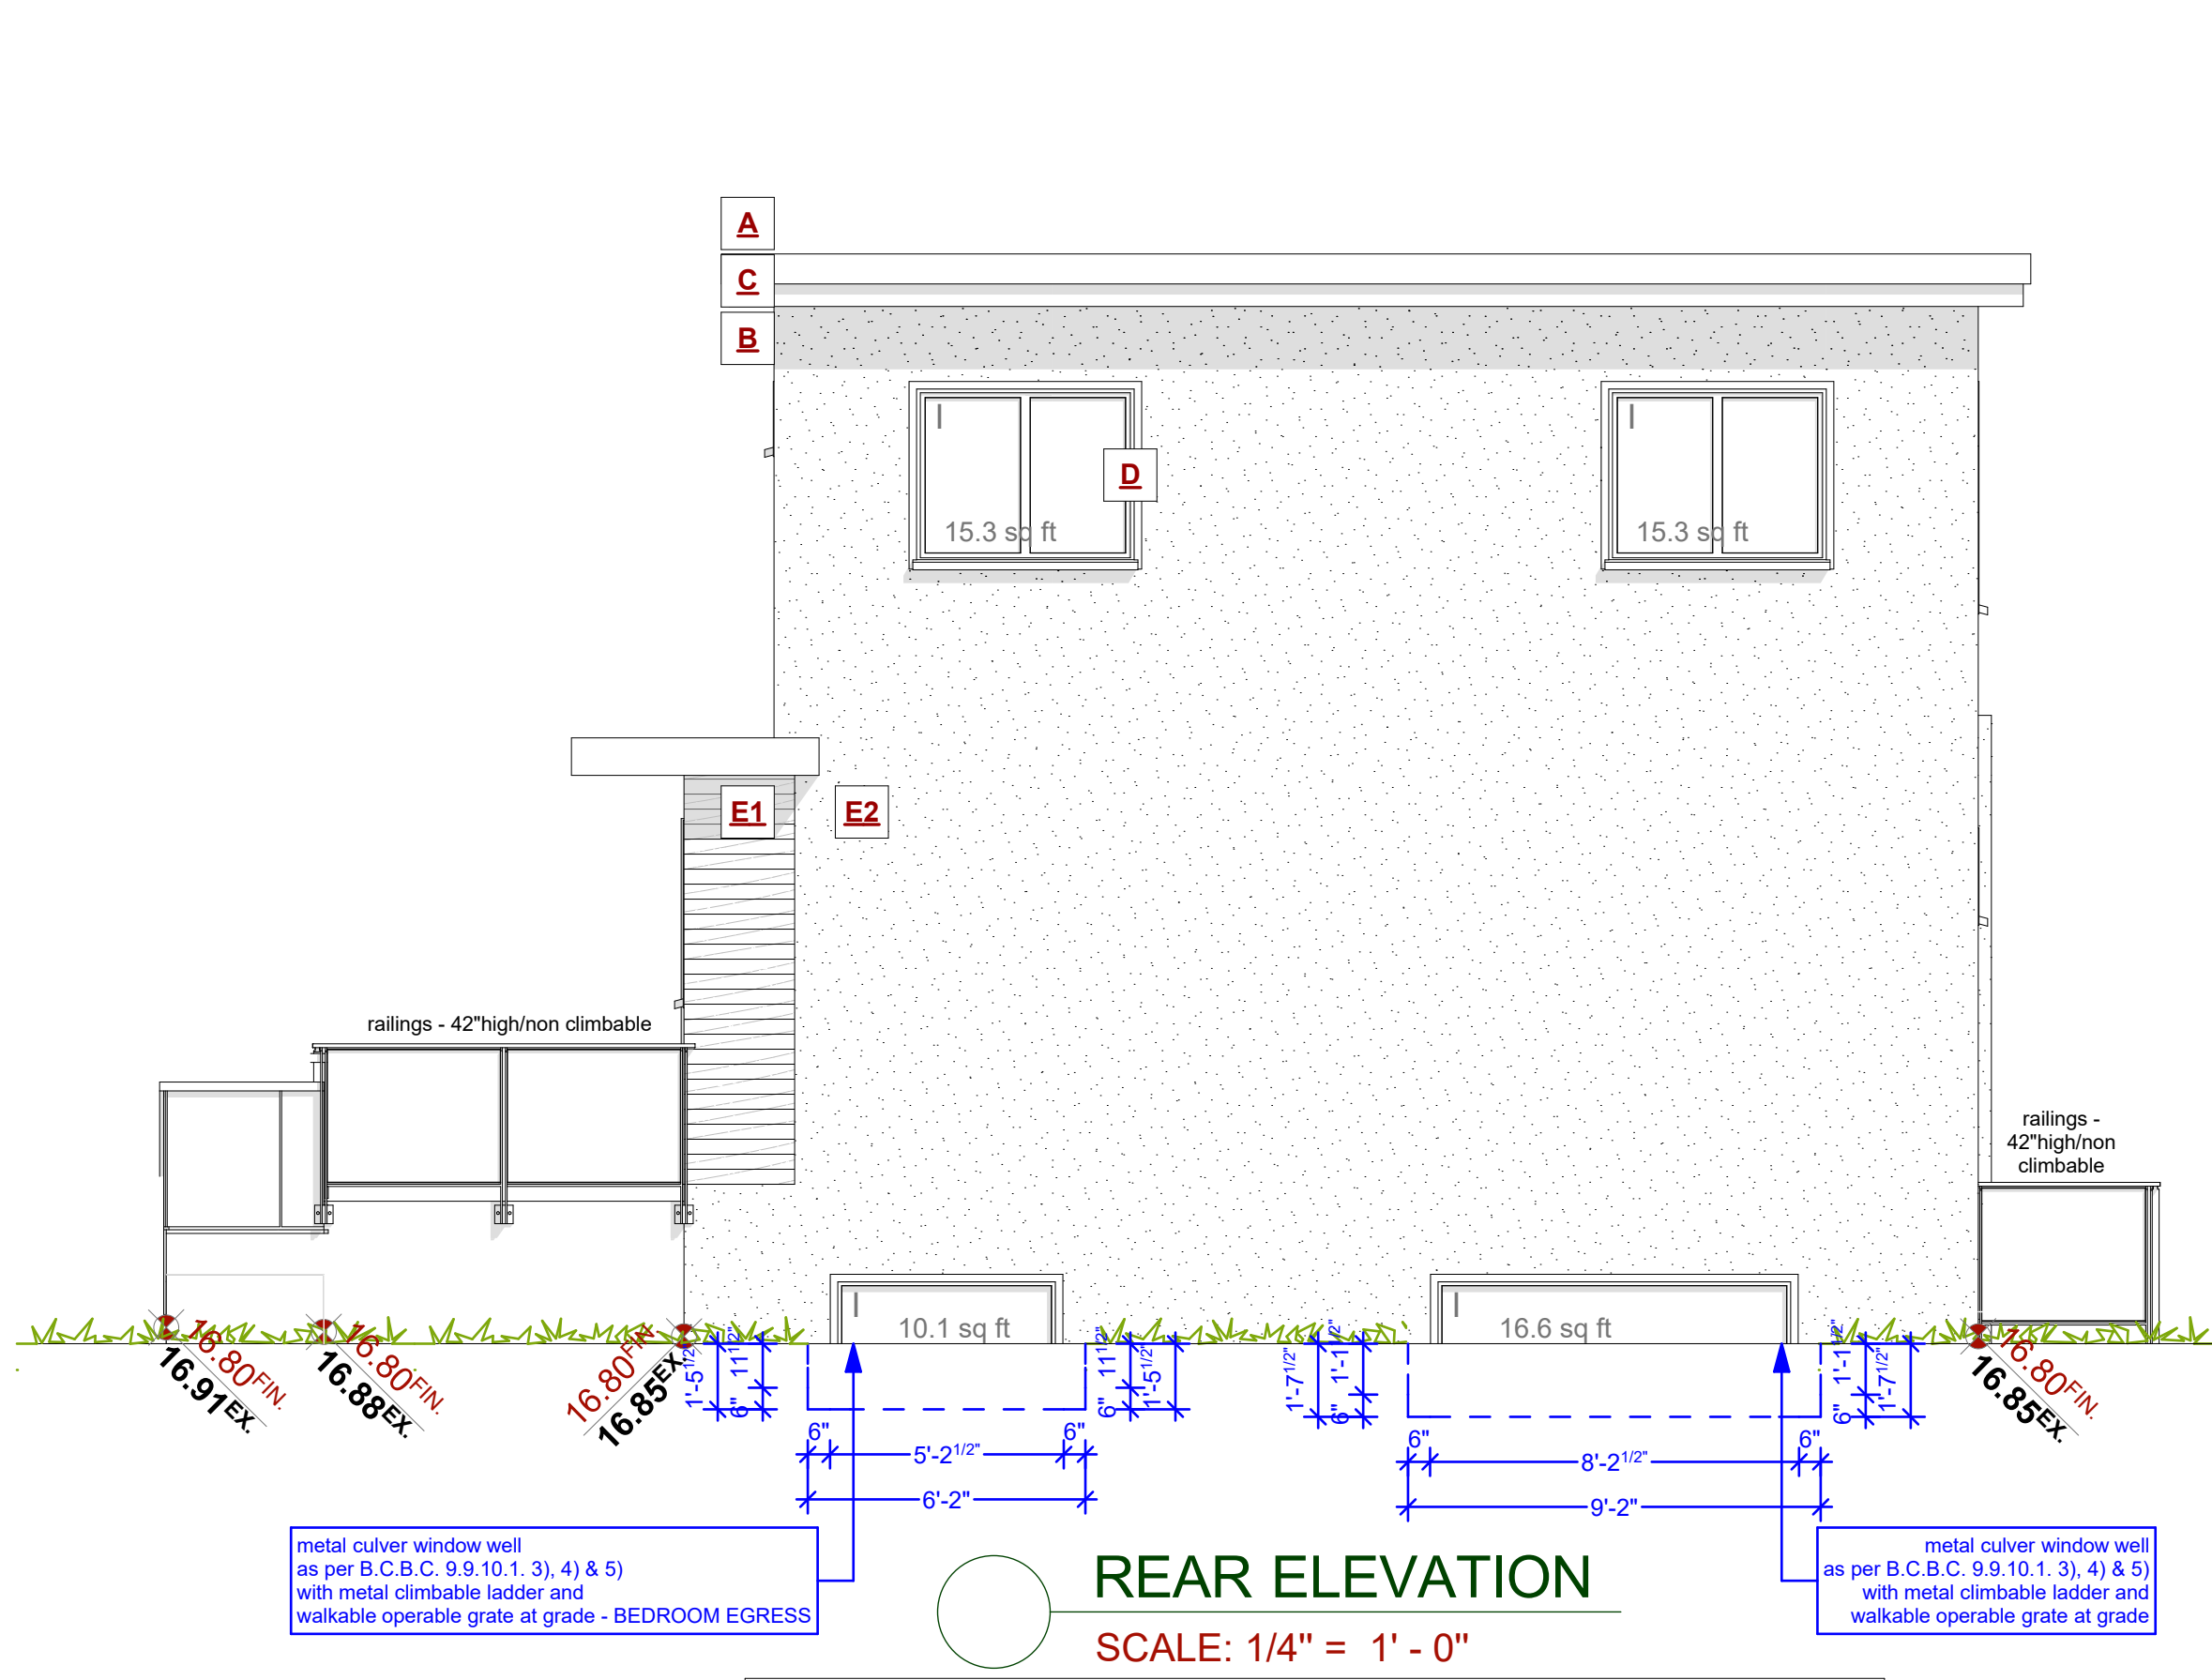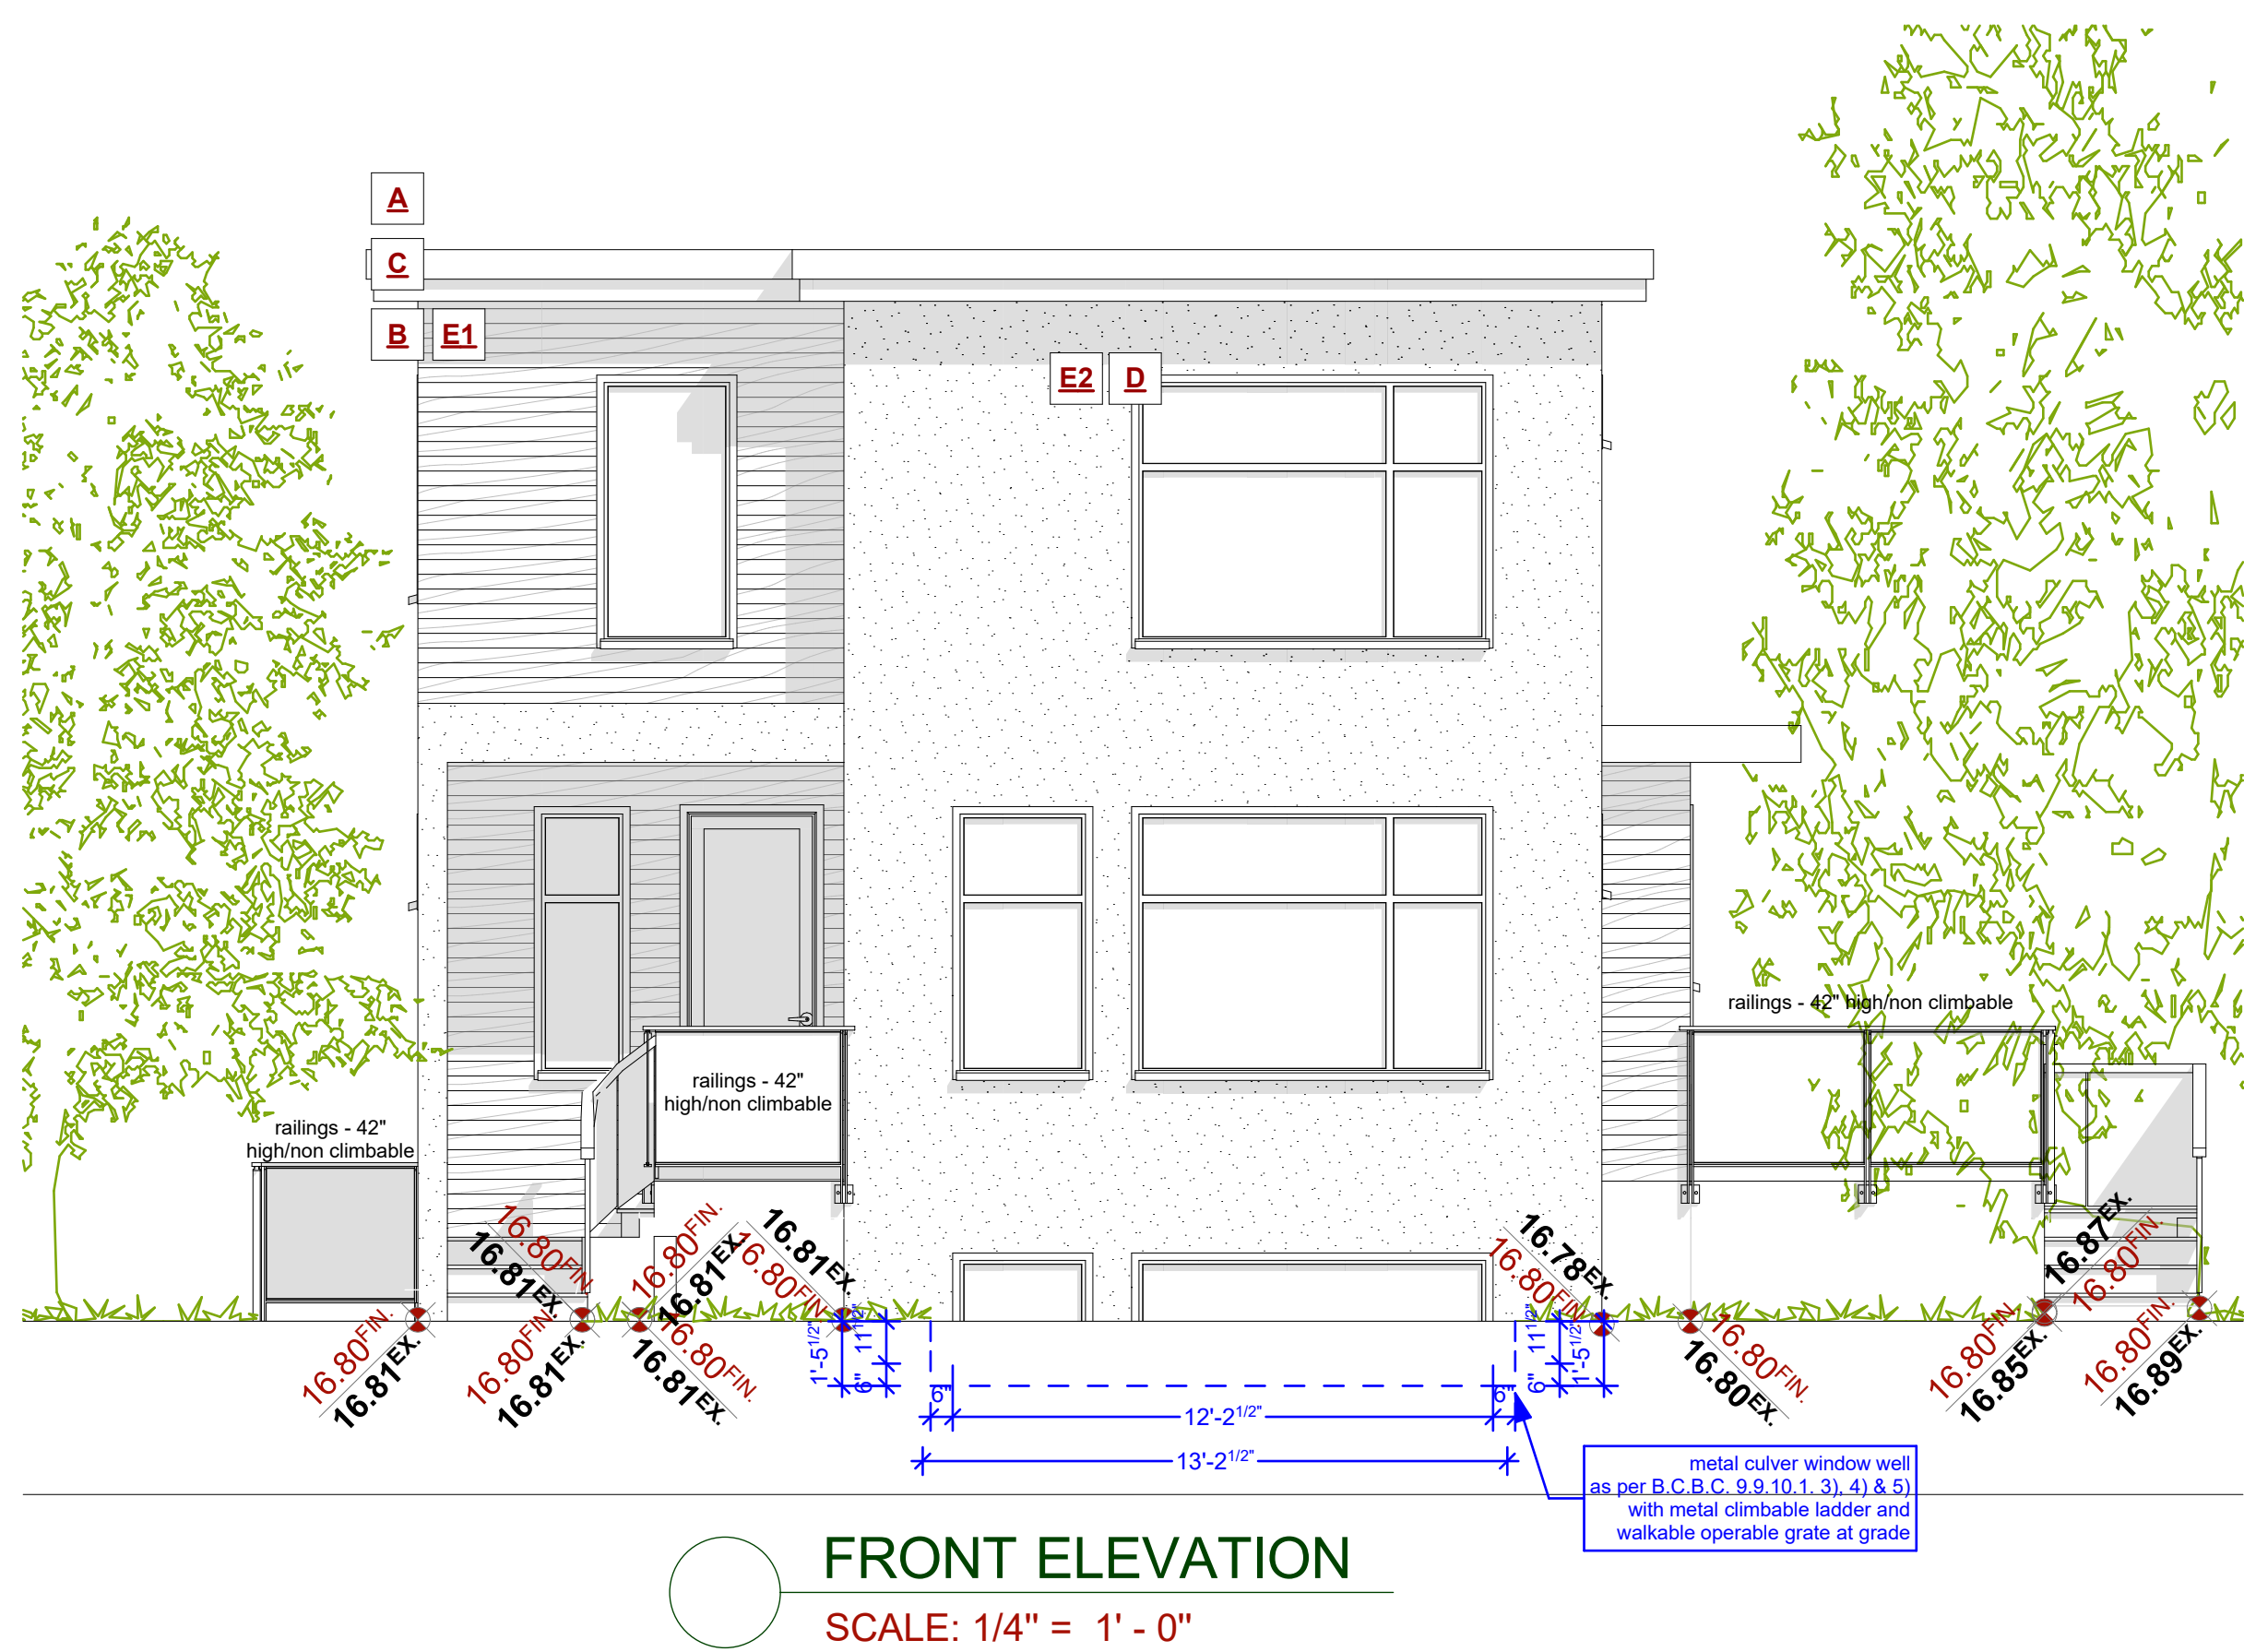

EXPOSING BUILDING FACE: 59.61m²
LIMITING DISTANCE: 2.41m
AREA OF GLAZED OPENINGS: 5.33m²
% GLAZED OPENINGS: 8.94%
45 min FIRE-RESISTANCE RATING: not required
TYPE OF CLADDING: no limits
PERMITTED % OF GLAZED OPENINGS (as per Table 9.10.15.4): 14.50%
PERMITTED AGGREGATE AREA OF GLAZED OPENINGS: 8.64m²

EXTERIOR FINISHES SCHEDULE		
A	ROOFING:	BUILT UP TORCH-ON/ METAL STANDING SEAM ROOFS AS PER CONTRACTORS SPECS
B	GUTTER & SOFFIT:	ALUMINIUM GUTTER AND NON-VENTED SOFFIT
C	BARGE BOARD:	2x10 WITH 1x4 DOUBLE BARGE BOARD, PAINTED TRIM COLOUR
D	WINDOW & DOOR TRIM:	1x4 TRIM BOARDS - PAINTED/ STAINED
E1	WALL FINISH:	HORIZONTAL CEDAR SIDING LAPPED TO 4" EXPOSURE. COLOUR AS PER BUILDERS SPECS
E2	WALL FINISH:	STUCCO - SEE OWNER FOR TEXTURE FINISH - RAIN SCREEN AS PER BCBC

ALL WINDOWS MUST COMPLY WITH BCBC AND NAFS REQUIREMENTS
MUST BE CLEARLY LABELED ON ALL WINDOW UNITS UPON INSTALLATION FOR INSPECTION
-ONE EXTERIOR DOOR IS PERMITTED TO HAVE A HIGHER U-VALUE OF 2.6, ALL OTHERS MUST BE LOWER.
-GARAGE VEHICULAR DOORS MUST BE MINIMUM NOMINAL RSI OF 1.1

NAFS REQUIREMENTS:

Performance Grade of 30
Water Test Pressure of 260 Pa

CUSTOMER:
MARIA WEEKS
ADDRESS:
**1905 LEE AVE.
LOT 4 PLAN 5969 SECTION 76 VICTORIA**

DRAWING NAME:
ELEVATIONS
DRAWING SCALE:
1/4"=1'-0"

ISSUE DATE:
FEB 16, 2020
DRAWN BY:
KYLE LEGGETT

JAVA DESIGNS
WHERE LINES ON PAPER BECOME WALLS ON SITE
PH 250.590.2468 FX 250.590.4577 www.javadesigns.ca

SHEET
NUMBER

A5

